


Thank you for joining our live webinar today.

We will begin shortly.
Please standby. Thank you.


Need Help?
Call ReadyTalk Support:
800.843.9166



Welded Connections
A Primer for Engineers



**Smarter.
Stronger.
Steel.**




Audio Options


Today's audio will be broadcast through the internet.

Alternatively, to hear the audio through the phone, dial:

(866)-519-2796
Passcode: 254072



**Smarter.
Stronger.
Steel.**




Today's live webinar will begin shortly. Please stand by.


As a reminder, all lines have been muted. Please type any questions or comments through the chat feature on the left portion of your screen.

Today's audio will be broadcast through the internet.
Alternatively, to hear the audio through the phone, dial:

(866)-519-2796
Passcode: 254072



**Smarter.
Stronger.
Steel.**




AIA Credit

AISC is a Registered Provider with The American Institute of Architects Continuing Education Systems (AIA/CES). Credit(s) earned on completion of this program will be reported to AIA/CES for AIA members. Certificates of Completion for both AIA members and non-AIA members are available upon request.

This program is registered with AIA/CES for continuing professional education. As such, it does not include content that may be deemed or construed to be an approval or endorsement by the AIA of any material of construction or any method or manner of handling, using, distributing, or dealing in any material or product.

Questions related to specific materials, methods, and services will be addressed at the conclusion of this presentation.



**Smarter.
Stronger.
Steel.**



Copyright Materials

This presentation is protected by US and International Copyright laws. Reproduction, distribution, display and use of the presentation without written permission of AISC is prohibited.

© The American Institute of Steel Construction 2019

The information presented herein is based on recognized engineering principles and is for general information only. While it is believed to be accurate, this information should not be applied to any specific application without competent professional examination and verification by a licensed professional engineer. Anyone making use of this information assumes all liability arising from such use.



Course Description

21.6 Seismic Welding Issues November 26, 2019

This session will discuss seismic design and ductility, the 1994 Northridge earthquake and the requirements of the AWS D1.8 Seismic Welding Supplement. AWS D1.8 will be reviewed with a specific focus on the requirements that must be specified by the Engineer, what compliance to these requirements looks like, and why such provisions are in the Code. AISC 358 – Prequalified Connections for Special and Intermediate Steel Moment Frames will be introduced.



Learning Objectives

- Name the key lessons learned from the Northridge earthquake and performance of moment connections.
- Describe the applicability of AISC 358: Prequalified Connections for Special and Intermediate Steel Moment Frames for Seismic Applications.
- Describe the applicability of AWS D1.8 Seismic Welding Supplement.
- List information that the Engineer of Record is required to provide in the Contract Documents per AWS D1.8.



Night School 21 Course Schedule

- | | |
|-------------------|-------------------------------------|
| 10/8/2019 | 1. Introduction and Weld Processes |
| 10/15/2019 | 2. Principles of Welded Connections |
| 10/29/2019 | 3. Welded Connection Details |
| 11/5/2019 | 4. Metallurgy and Cracking |
| 11/19/2019 | 5. Fatigue of Welded Connections |
| 11/26/2019 | 6. Seismic Welding Issues |
| 12/3/2019 | 7. Special Welding Applications |
| 12/10/2019 | 8. Problems and Fixes |



Night School 21 Welded Connections -- A Primer for Engineers

Session 6: Seismic Welding Issues
November 26, 2019



Duane K. Miller, PE, ScD
Manager of Engineering Services and Welding
Design Consultant




SEISMIC WELDING ISSUES



AISC Design Guide 21, 2nd Edition

Welded Connections – A Primer for
Engineers

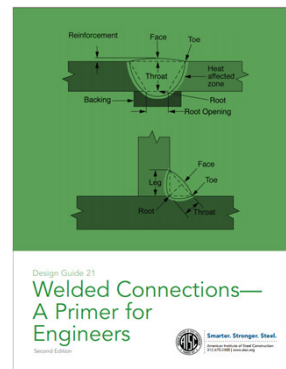



SEISMIC WELDING ISSUES



Chapter 11 Seismic Welding Issues

- 11.1 Introduction
- 11.2 The Northridge Earthquake
- 11.3 Seismic Welding Specifications
- 11.4 Seismic Terminology
- 11.5 AWS D1.8
- 11.6 AISC *Seismic Provisions* Welding Requirements
- 11.7 AISC *Prequalified Connections* Welding Requirements
- 11.8 Welded Details For Prequalified Connections



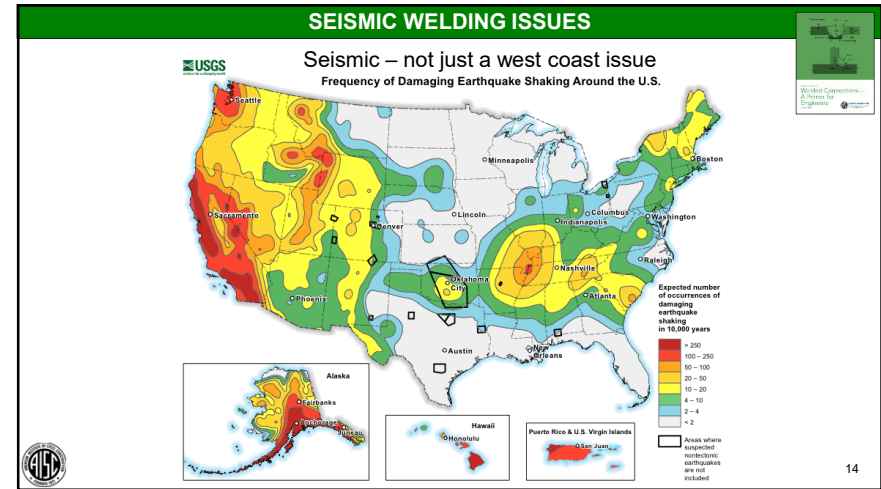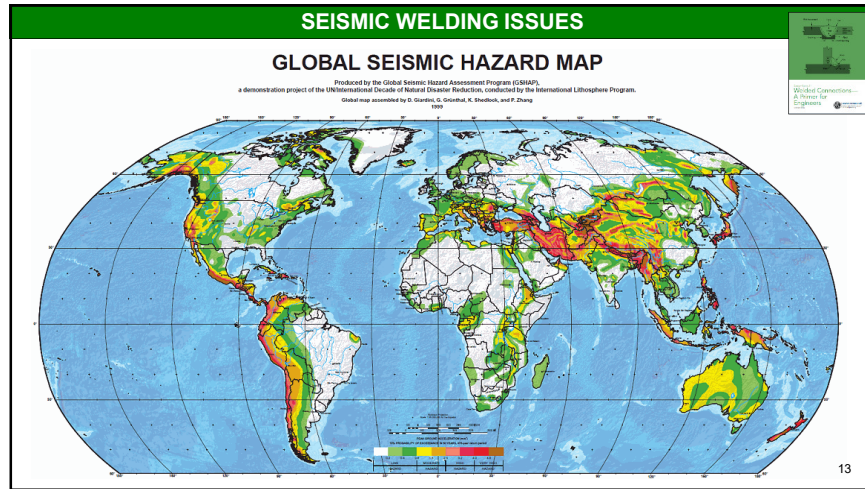

SEISMIC WELDING ISSUES

Outline

- Seismic Design and Ductility
- The Northridge Experience
- AISC Prequalified Seismic Connections
- D1.8 Seismic Welding Supplement
- Conclusion

15

ANS/AISC 341-16

Seismic Provisions for Structural Steel Buildings

ANS/AISC 341-16
An American National Standard

Seismic Provisions for Structural Steel Buildings

July 11, 2016

Supersedes the Seismic Provisions for Structural Steel Buildings, dated June 12, 2010 and all previous versions

Approved by the Committee on Specifications



AMERICAN INSTITUTE OF STEEL CONSTRUCTION
110 East Wacker Drive, Suite 2000, Chicago, Illinois 60601
www.aisc.org

16

AISC 341-16 SEISMIC PROVISIONS

COMMENTARY CHAPTER A
GENERAL REQUIREMENTS



A1. Scope
Structural steel systems in seismic regions are generally expected to dissipate seismic input energy through **controlled inelastic deformations of the structure**. The Provisions supplement the *Specification* for such applications. The seismic design loads specified in the building codes have been developed considering the **energy dissipation generated during inelastic response**.

17

ANSI/AISC 358-16
ANSI/AISC 358s1-18

Prequalified Connections for Special and Intermediate Steel Moment Frames for Seismic Applications, including Supplement No. 1



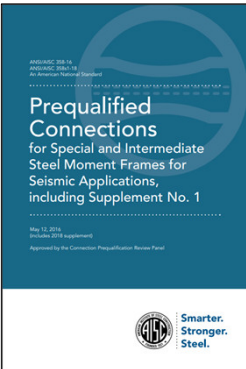


18

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

COMMENTARY CHAPTER 1
GENERAL



1.1. Scope
Design of special moment frames (SMF) and intermediate moment frames (IMF) in accordance with the AISC *Seismic Provisions for Structural Steel Buildings*... and applicable building codes **includes an implicit expectation that they will experience substantial inelastic deformations when subjected to design-level earthquake ground shaking, generally concentrated at the moment-resisting beam-to-column connections**.





19



SEISMIC WELDING ISSUES

Special Moment Frame


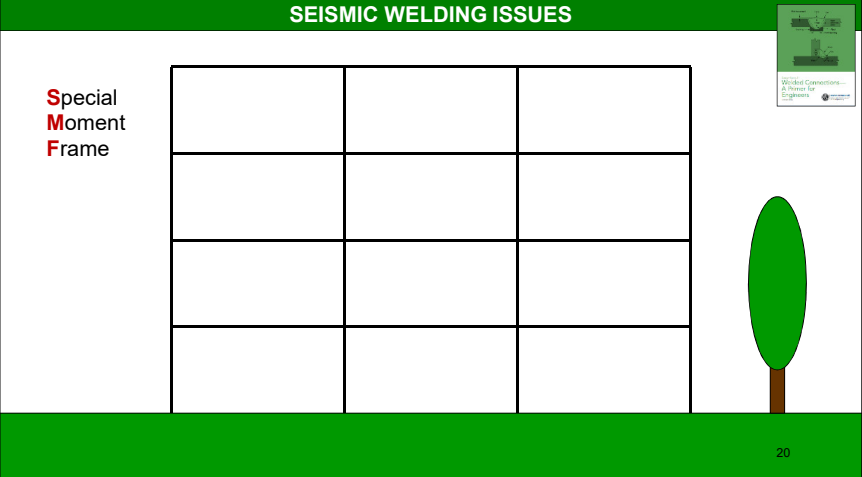



20

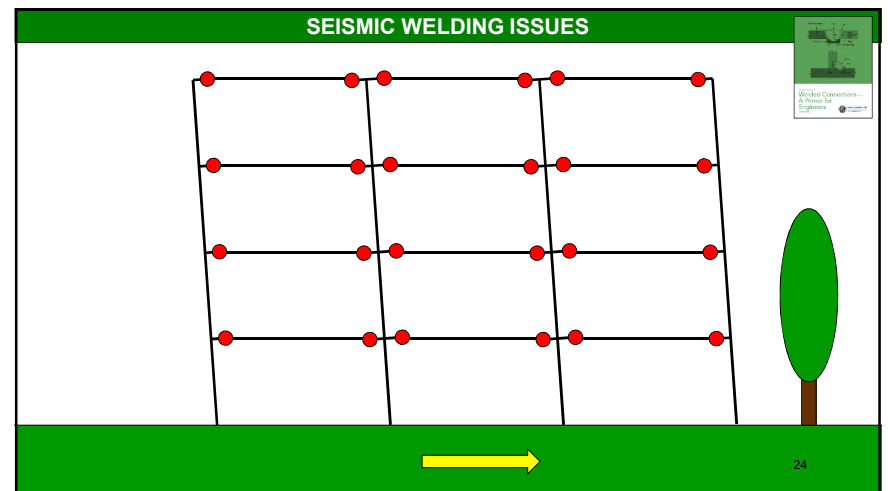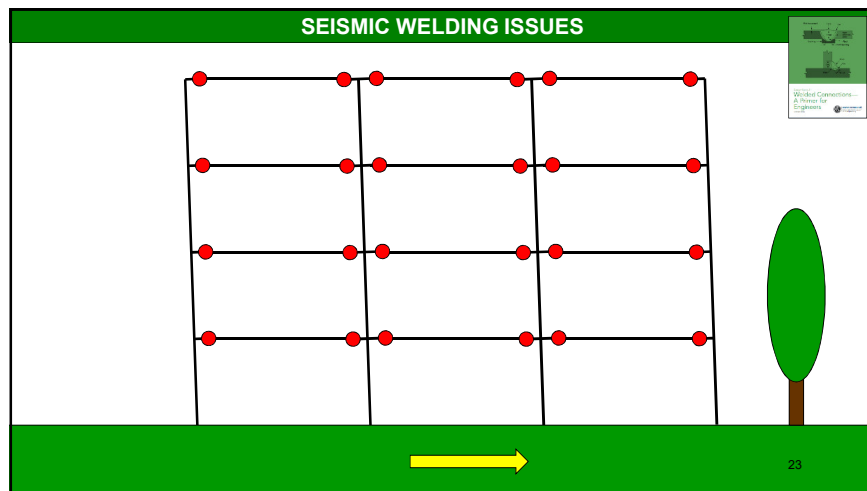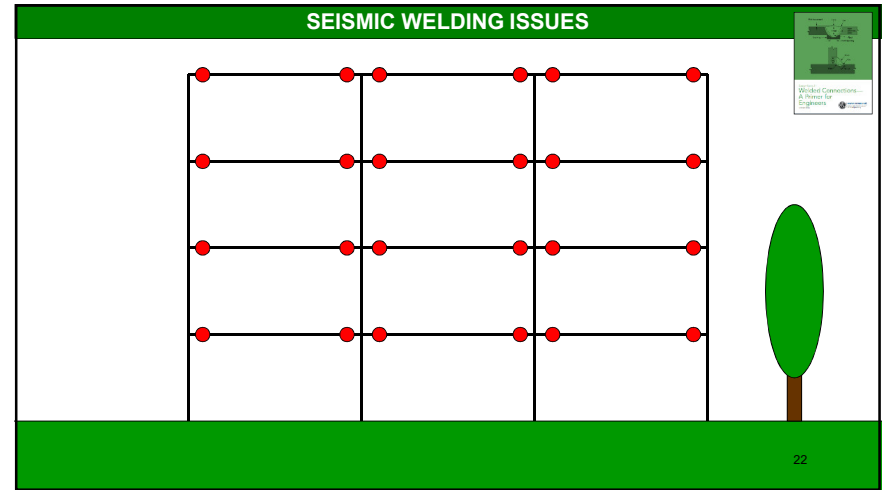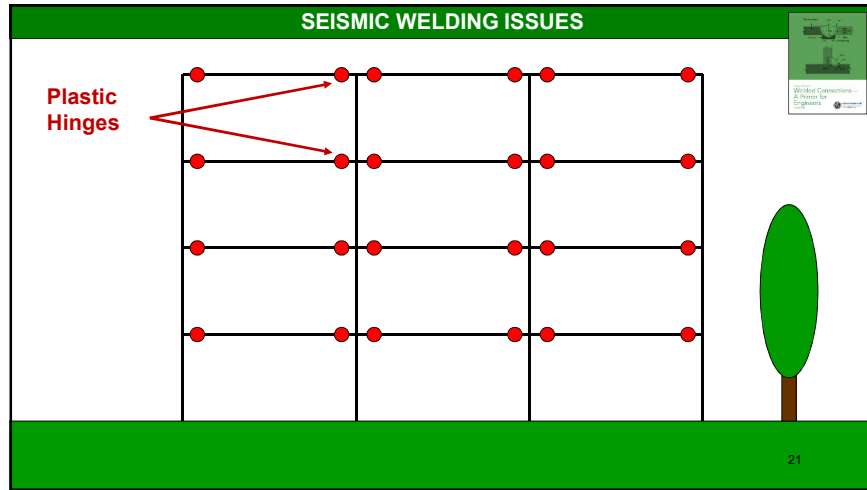

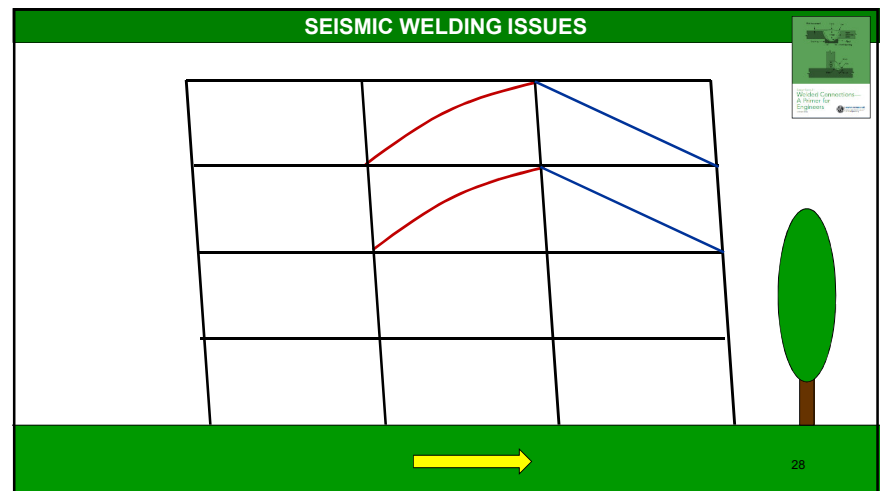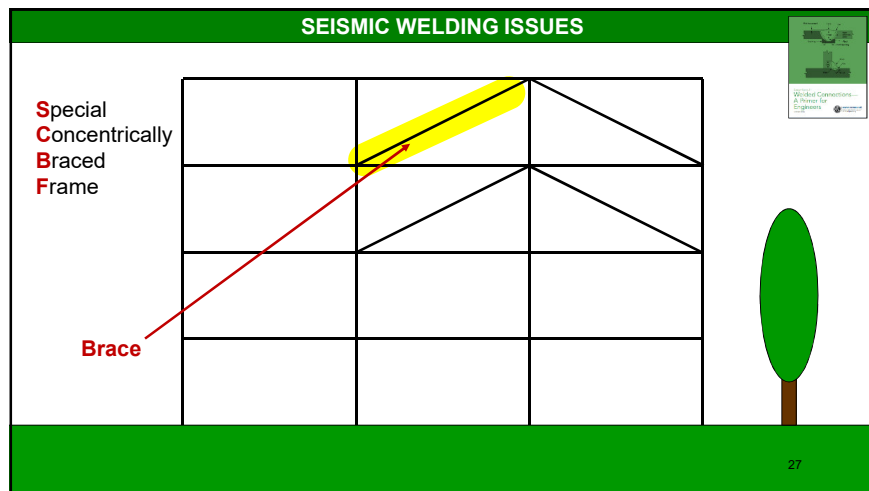



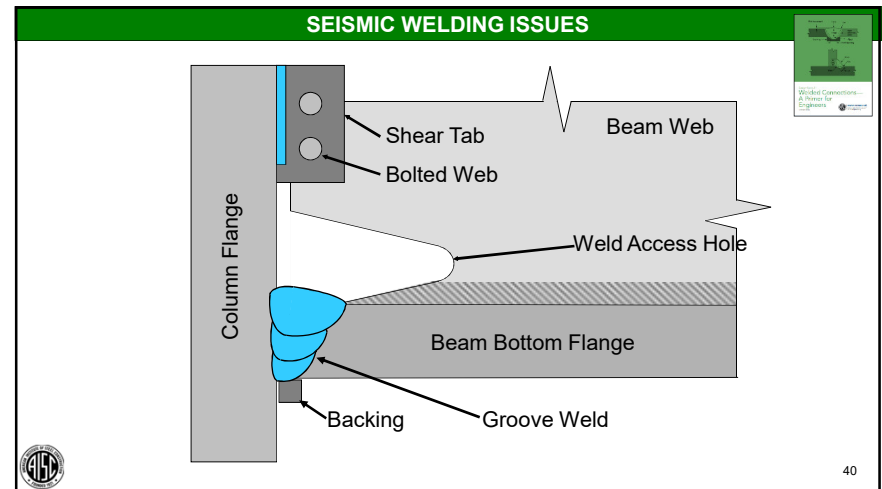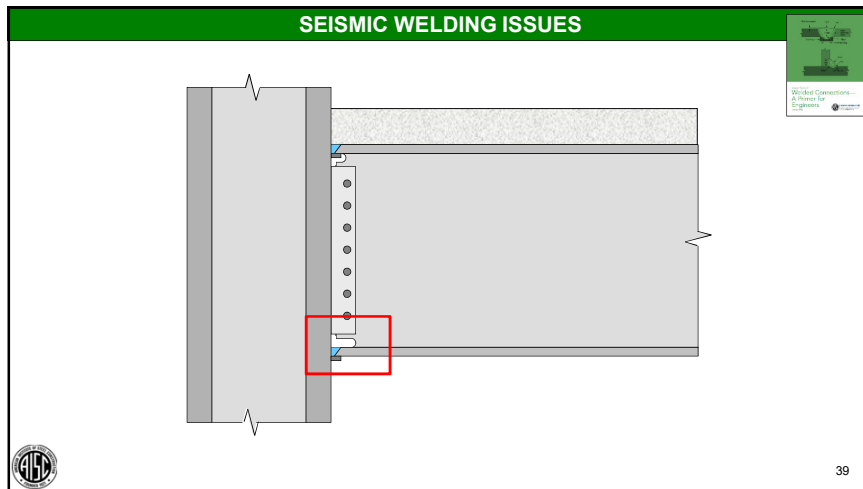

FEMA 267 - Interim Guidelines: Evaluation, Repair, Modification and Design of Welded Steel Moment Frame Structures

Figure 3-2 Types of Girder Damage


Type	Description
G1	Buckled flange (top or bottom)
G2	Yielded flange (top or bottom)
G3	Flange fracture in HAZ (top or bottom)
G4	Flange fracture outside HAZ (top or bottom)
G5	Flange fracture top and bottom
G6	Yielding or buckling of web
G7	Fracture of web
G8	Lateral torsional buckling of section

41

SEISMIC WELDING ISSUES

Type G3




42




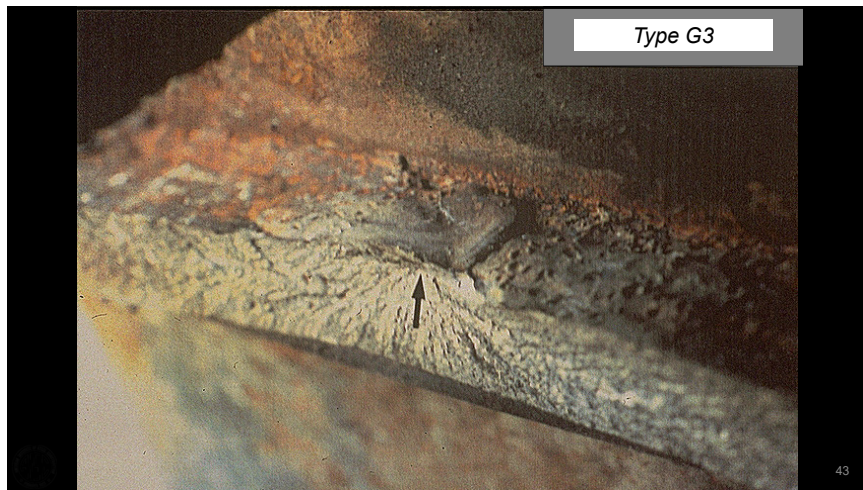




SEISMIC WELDING ISSUES


Type C2

44

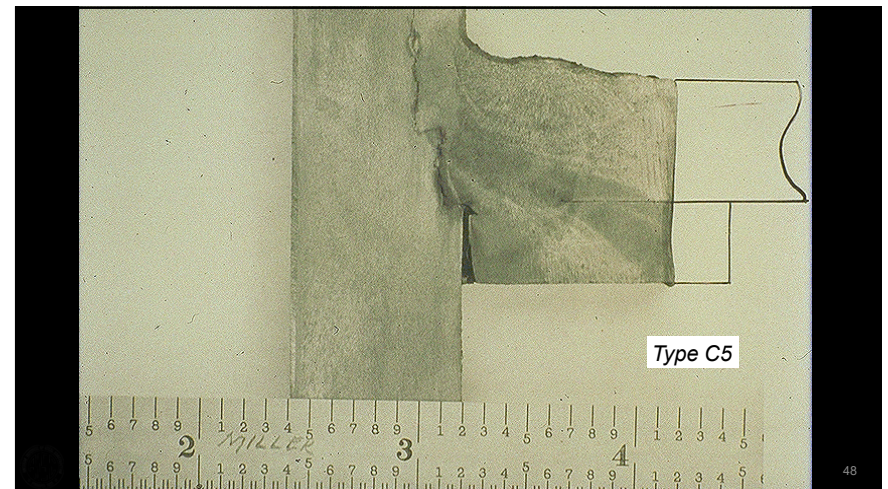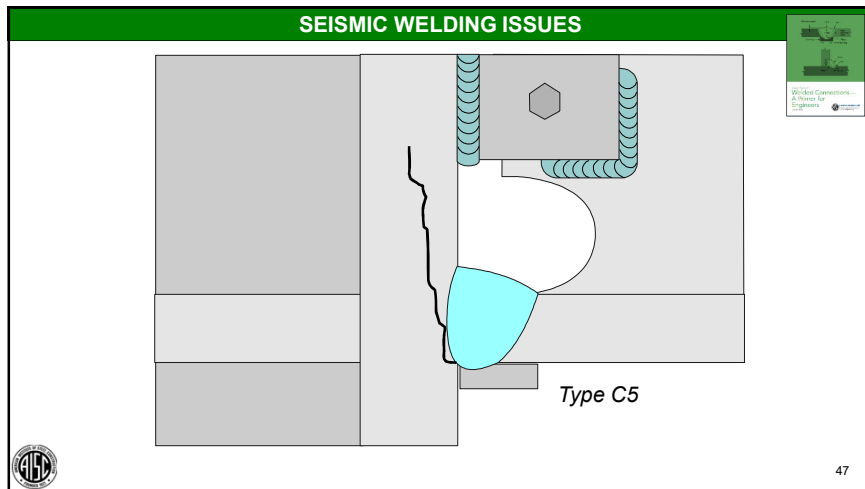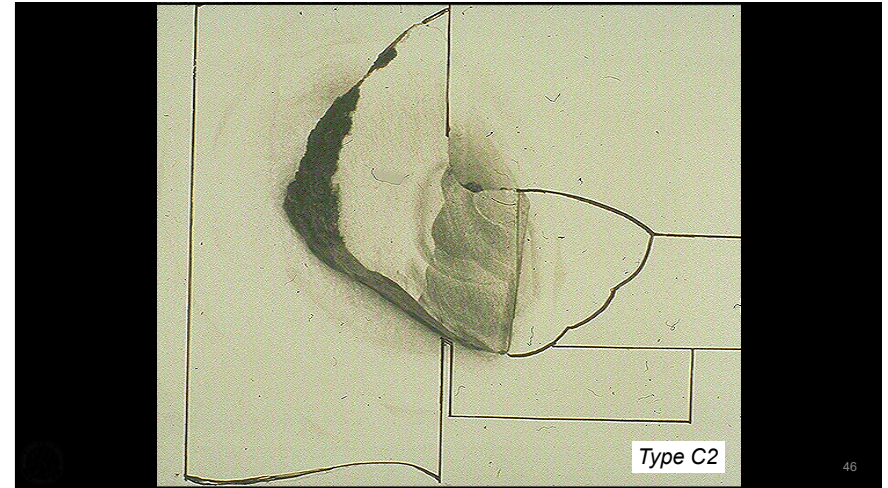

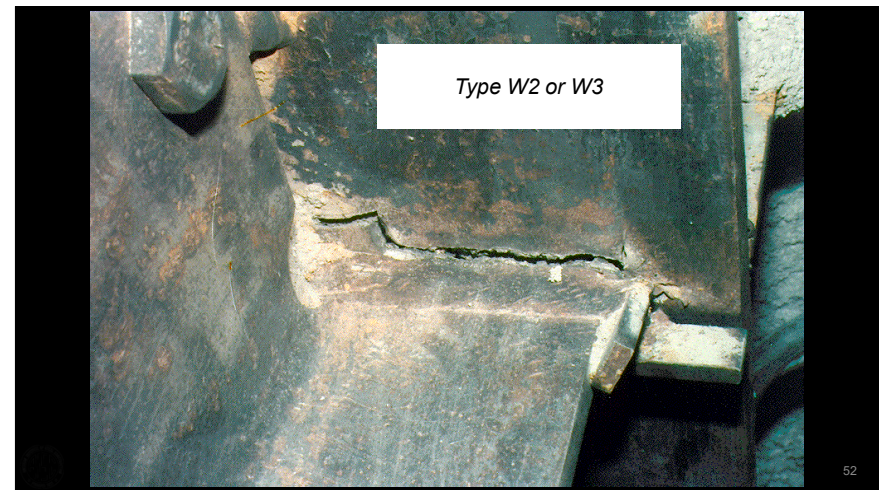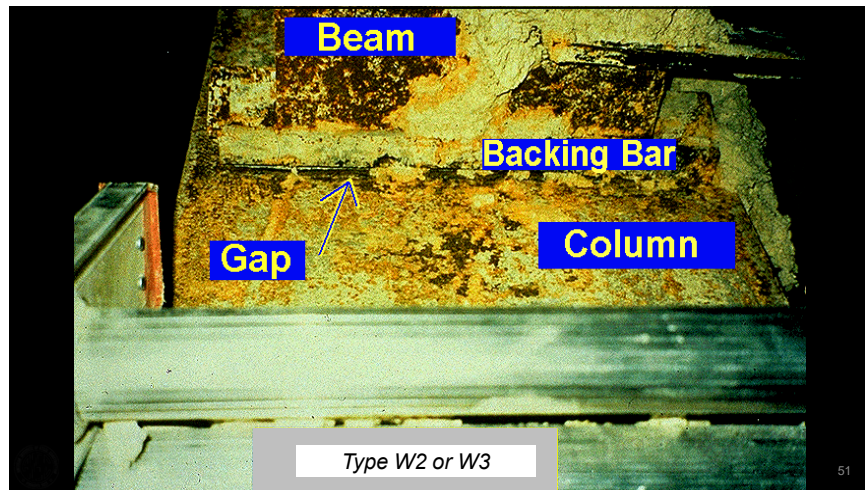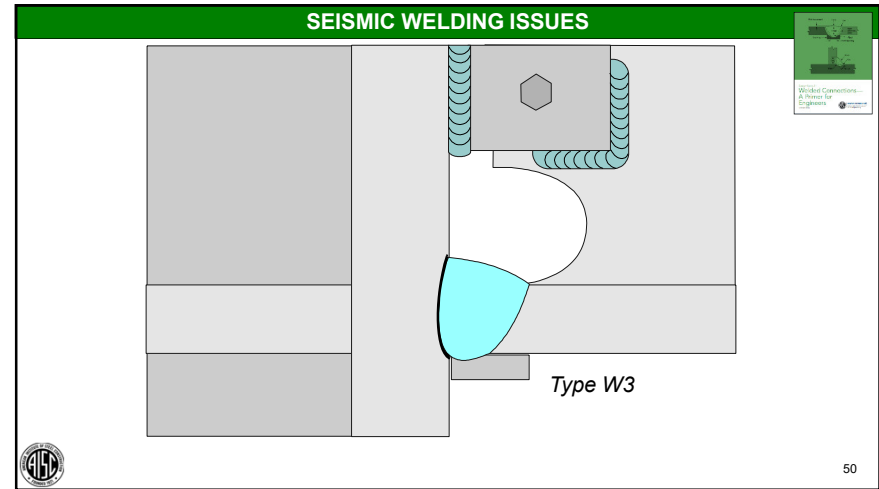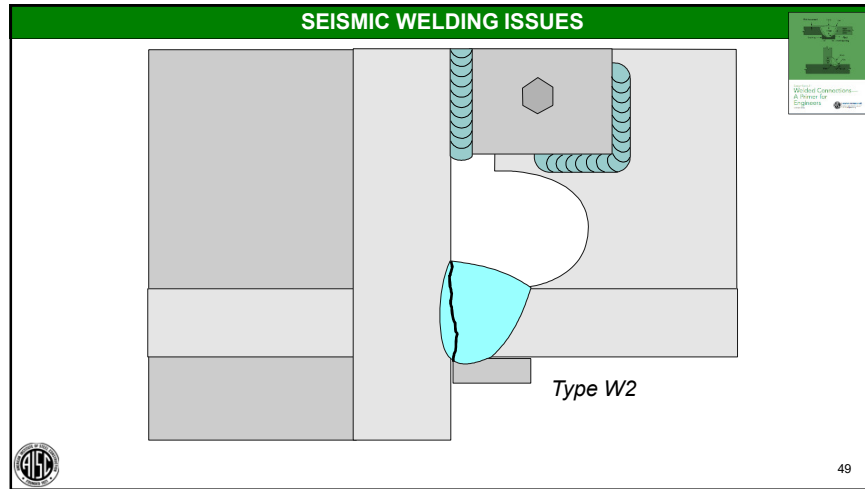

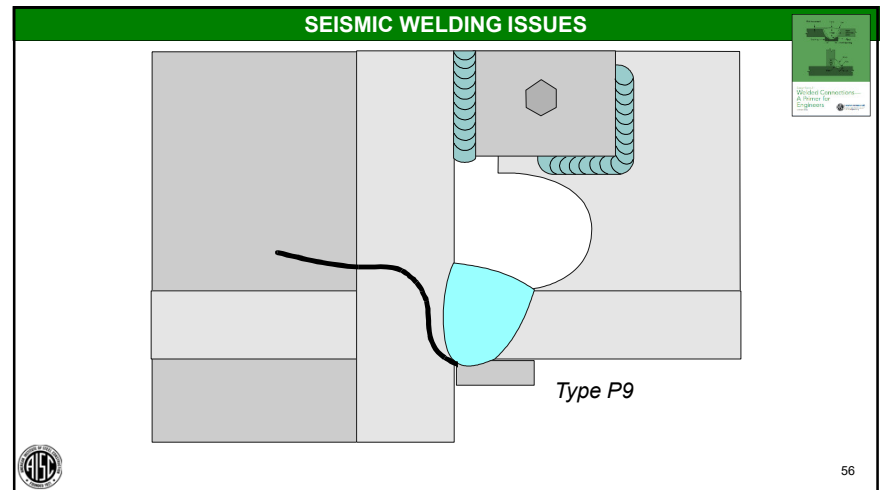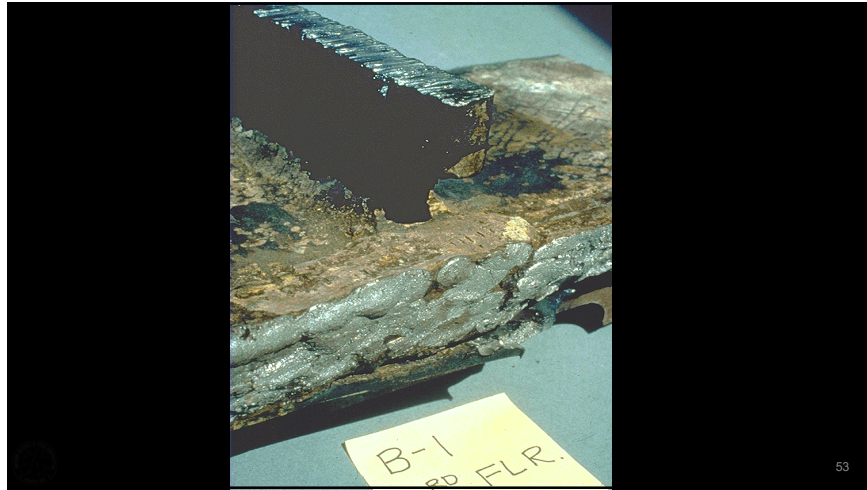

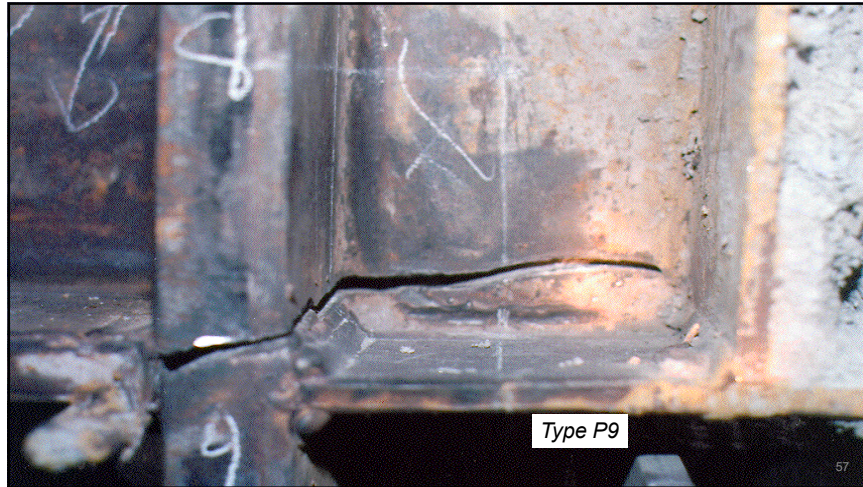

Federal Emergency Management Agency (FEMA)

FEMA 353: Recommended Specifications and Quality Assurance Guidelines for Steel Moment-Frame Construction for Seismic Applications
July 2000

58

FEMA 353: Recommended Specifications and Quality Assurance Guidelines for Steel Moment-Frame Construction for Seismic Applications

“As a result of these studies, and independent research conducted by others, it is now known that the typical moment-resisting connection detail employed in steel moment-frame construction prior to the 1994 Northridge earthquake...had a number of features that rendered it inherently susceptible to brittle fracture. These included the following:”

(seven items are then listed)

From FEMA 353, page 1-9

59

FEMA 353: Recommended Specifications and Quality Assurance Guidelines for Steel Moment-Frame Construction for Seismic Applications

- “The most severe stresses in the connection assembly occur where the beam joins to the column.”
- “...the weld...must be interrupted at the beam web, with either a start or stop of the weld at this location. This welding technique often results in poor quality welding at this critical location....”
- “The basic configuration of the connection makes it difficult to detect hidden defects at the root of the welded beam-flange-to-column-flange joints.”

60

FEMA 353: Recommended Specifications and Quality Assurance Guidelines for Steel Moment-Frame Construction for Seismic Applications

- "... the beam flanges at the connection carry a significant amount of the beam shear. This results in significant flexural stresses on the beam flange at the face of the column...."
- "... severe strain concentrations can occur in the beam flange at the toe of these weld access holes. These strain concentrations can result in low-cycle fatigue and the initiation of ductile tearing of the beam flanges...."



61

FEMA 353: Recommended Specifications and Quality Assurance Guidelines for Steel Moment-Frame Construction for Seismic Applications

- "Steel material at the center of the beam-flange-to-column-flange joint is restrained from movement, particularly in connections of heavy sections with thick column flanges. This condition of restraint inhibits the development of yielding at this location, resulting in locally high stresses on the welded joint, which exacerbates the tendency to initiate fractures at defects in the welded joints."



62

FEMA 353: Recommended Specifications and Quality Assurance Guidelines for Steel Moment-Frame Construction for Seismic Applications

- "In connections with excessively weak panel zones, inelastic behavior of the assembly is dominated by shear deformation of the panel zone. This panel zone shear deformation results in a local kinking of the column flanges adjacent to the beam-flange-to-column-flange joint...."



63

FEMA 353: Recommended Specifications and Quality Assurance Guidelines for Steel Moment-Frame Construction for Seismic Applications

"In addition to the above, additional conditions contributed significantly to the vulnerability of connections constructed prior to 1994."

(three items are then listed)


From FEMA 353, page 1-10



64

FEMA 353: Recommended Specifications and Quality Assurance Guidelines for Steel Moment-Frame Construction for Seismic Applications


- “The **welding consumables** that building erectors most commonly used **inherently produced welds with very low toughness.**”
- “... as **member sizes increased**, **strain demands on the welded connections also increased**, making the connections more susceptible to brittle behavior.”
- “... many **beams** actually had **yield strengths that approximated or exceeded that required for grade 50 material.** As a result of this increase in base metal yield strength, the weld metal in the beam-flange-to-column-flange joints became under-matched....”




65

FEMA 353: Recommended Specifications and Quality Assurance Guidelines for Steel Moment-Frame Construction for Seismic Applications

“At this time, it is clear that in order to obtain reliable **ductile behavior** of steel moment-frame construction a **number of changes to past practices** in **design, materials, fabrication, erection and quality assurance** are necessary.”

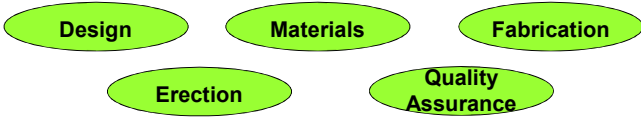

From FEMA 353, page 1-10




66


SEISMIC WELDING ISSUES

Outline

- Seismic Design and Ductility
- The Northridge Experience
- ➔ • AISC Prequalified Seismic Connections
- D1.8 Seismic Welding Supplement
- Conclusion




67

68

ANSI/AISC 358-16
ANSI/AISC 358s1-18

Prequalified Connections for Special and Intermediate Steel Moment Frames for Seismic Applications, including Supplement No. 1

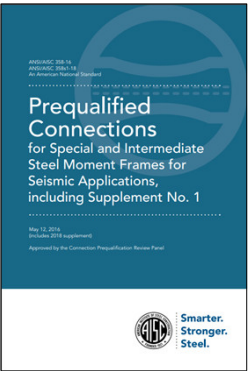

Smarter. Stronger. Steel.

69

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

CHAPTER 1
GENERAL

1.1. Scope

This Standard specifies design, detailing, fabrication and quality criteria for connections that are prequalified in accordance with the AISC *Seismic Provisions for Structural Steel Buildings* (herein referred to as the AISC *Seismic Provisions*) for use with special moment frames (SMF) and intermediate moment frames (IMF). The connections contained in this Standard are prequalified to meet the requirements in the AISC *Seismic Provisions* only when designated and constructed in accordance with the requirements of this Standard.

70

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

TABLE 2.1.
Prequalified Moment Connections

Connection Type	Chapter	Systems
Reduced beam section (RBS)	5	SMF, IMF
Bolted unstiffened extended end plate (BUEEP)	6	SMF, IMF
Bolted stiffened extended end plate (BSEEP)	6	SMF, IMF
Bolted flange plate (BFP)	7	SMF, IMF
Welded unreinforced flange-welded web (WUF-W)	8	SMF, IMF
Kaiser bolted bracket (KBB)	9	SMF, IMF
ConXtech ConXL moment connection (ConXL)	10	SMF, IMF
SidePlate moment connection (SidePlate)	11	SMF, IMF
Simpson Strong-Tie Strong Frame moment connection	12	SMF, IMF
Double-tee moment connection	13	SMF, IMF

71

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

CHAPTER 3
WELDING REQUIREMENTS

3.1. FILLER METALS

Filler metals shall conform to the requirements of the AISC *Seismic Provisions*.


3.2. WELDING PROCEDURES

Welding procedures shall be in accordance with the AISC *Seismic Provisions*.

72

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

3.3. BACKING AT BEAM-TO-COLUMN AND CONTINUITY
PLATE-TO-COLUMN JOINTS




73


AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

GLOSSARY

Backing. Piece of metal or other material, placed at the weld root to facilitate placement of the root pass.




74

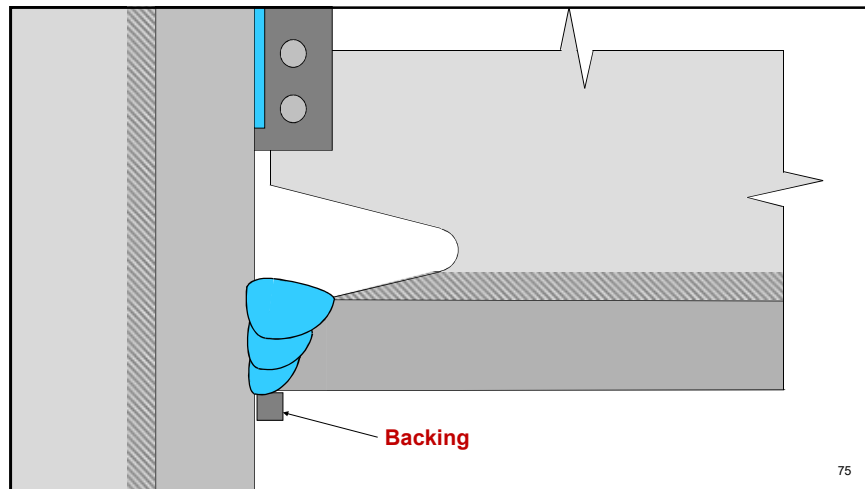



AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

GLOSSARY

Nonfusible backing. Backing material that will not fuse with the base metals during the welding process.



76

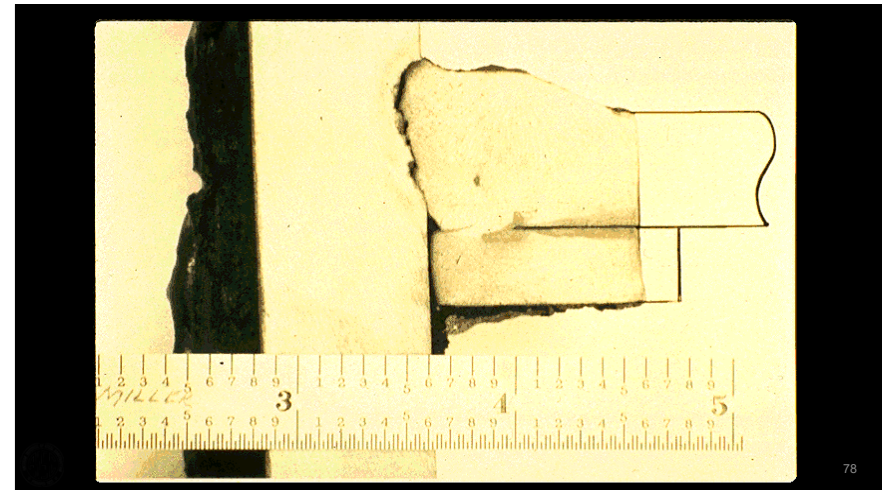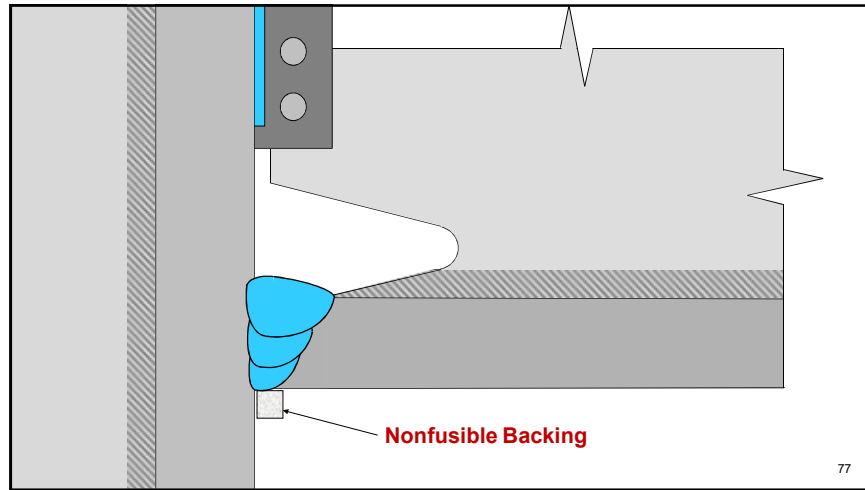

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

3.3. BACKING AT BEAM-TO-COLUMN AND CONTINUITY PLATE-TO-COLUMN JOINTS

1. Steel Backing at Continuity Plates

Steel backing used at continuity plate-to-column welds need not be removed. At column flanges, steel backing left in place shall be attached to the column flange using a continuous 5/16 in. (8-mm) fillet weld on the edge below the CJP groove weld. When backing is removed, the root pass shall be backgouged to sound weld metal and backwelded with a reinforcing fillet. The reinforcing fillet shall be continuous with a minimum size of 5/16 in. (8 mm).

79





AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS



3.3. BACKING AT BEAM-TO-COLUMN AND CONTINUITY PLATE-TO-COLUMN JOINTS

2. Steel Backing at Beam Bottom Flange

Where steel backing is used with CJP groove welds between the bottom beam flange and the column, the backing shall be removed. Following the removal of steel backing, the root pass shall be backgouged to sound weld metal and backwelded with a reinforcing fillet. The size of the reinforcing fillet leg adjacent to the column flange shall be a minimum of 5/16 in. (8 mm), and the reinforcing fillet leg adjacent to the beam flange shall be such that the fillet toe is located on the beam flange base metal.

80

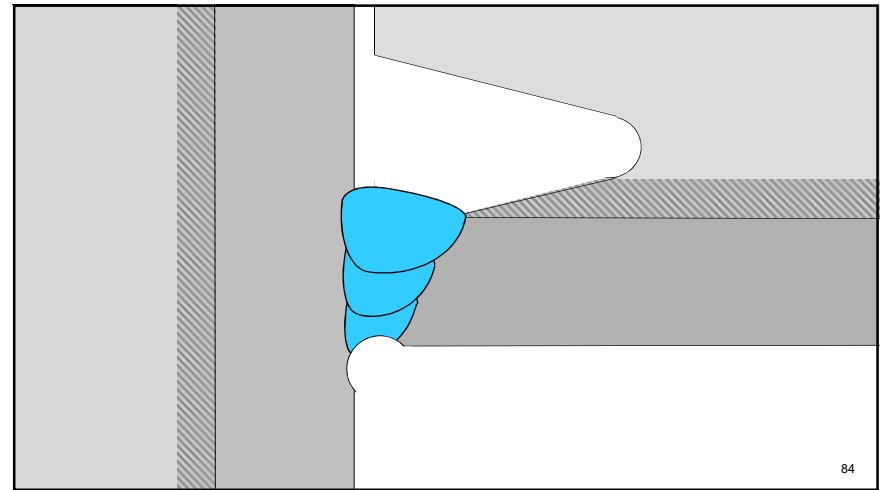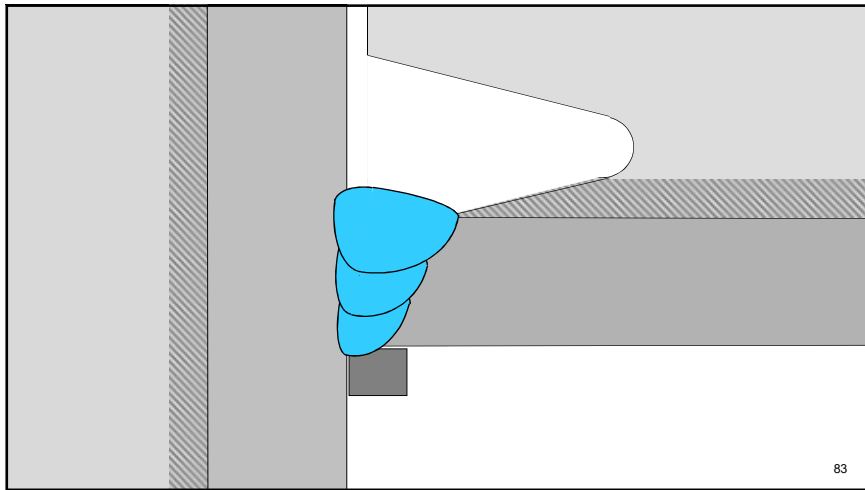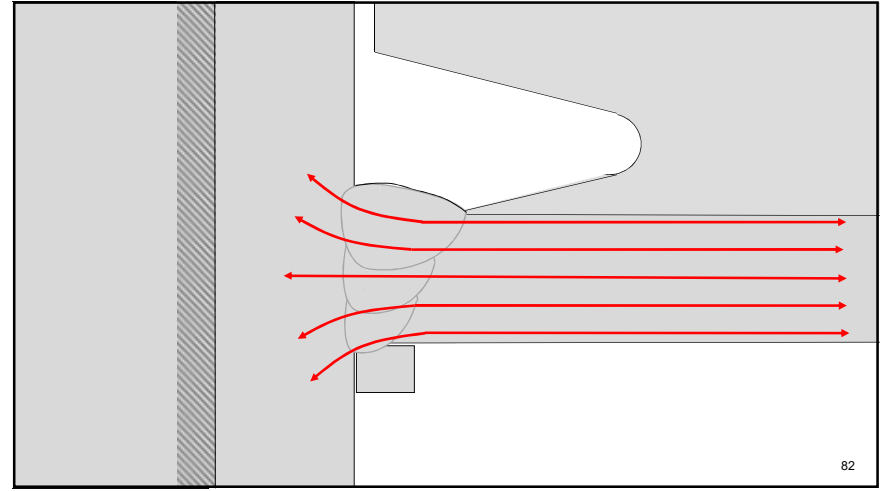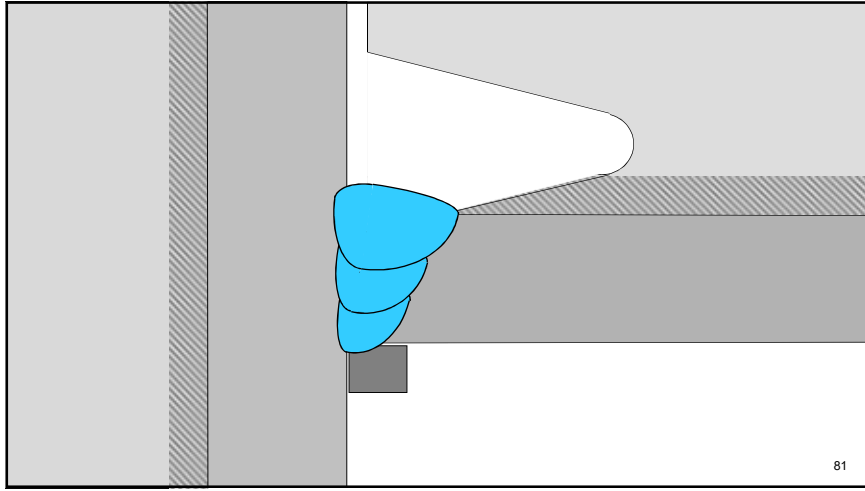

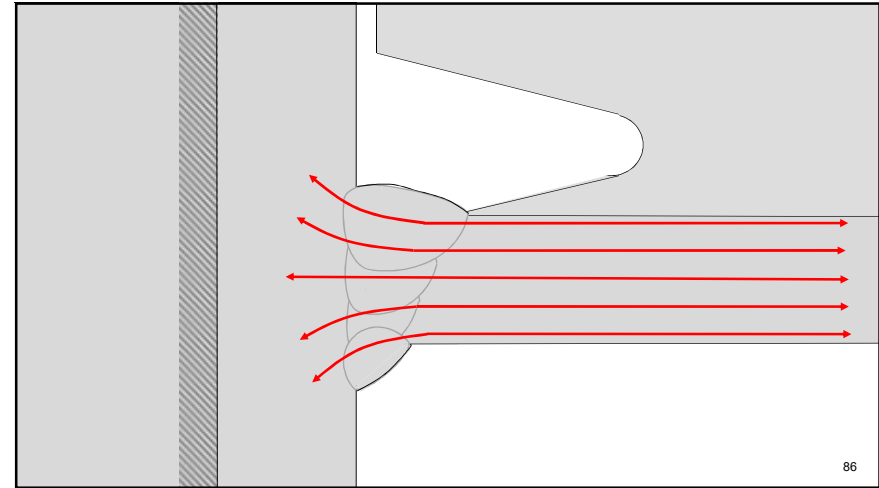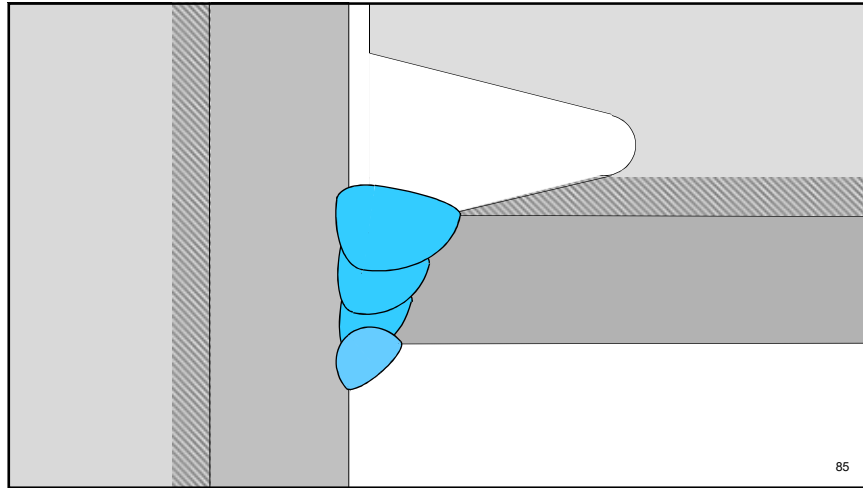


AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS


3.3. BACKING AT BEAM-TO-COLUMN AND CONTINUITY PLATE-TO-COLUMN JOINTS





3. Steel Backing at Beam Top Flange



Where steel backing is used with CJP groove welds between the top beam flange and the column, and the steel backing is not removed, the steel backing shall be attached to the column by a continuous 5/16 in. (8 mm) fillet weld on the edge below the CJP groove weld.



87

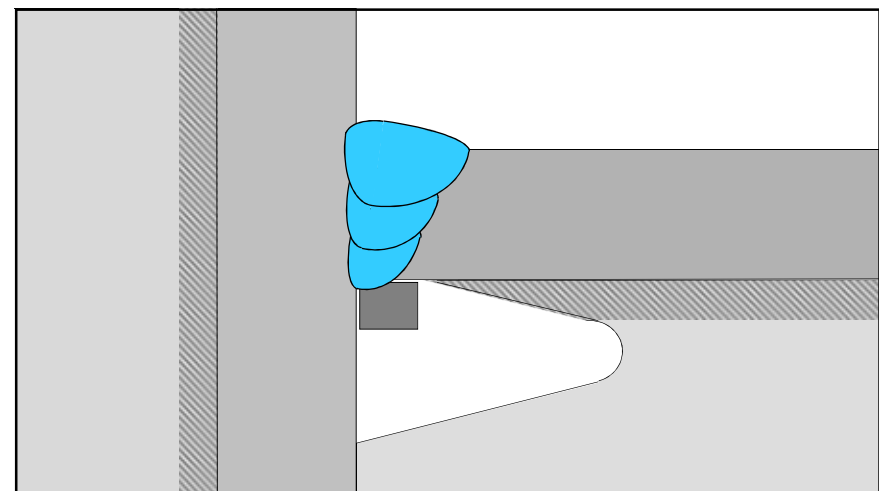

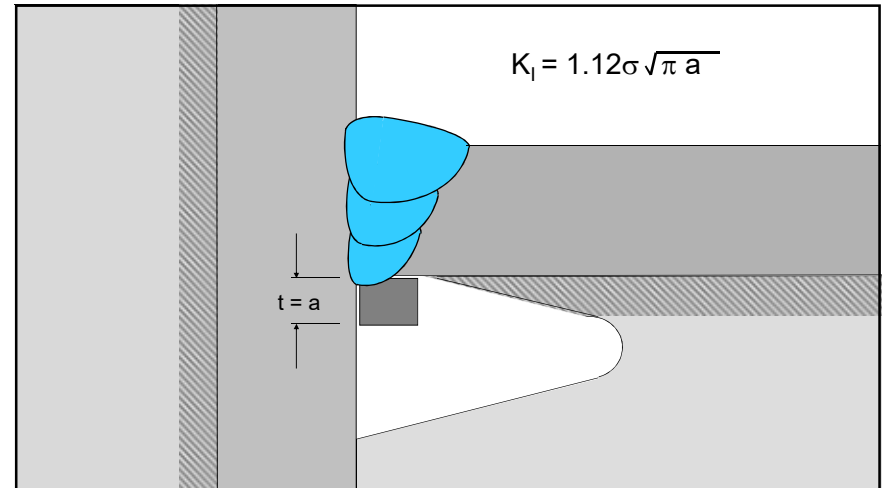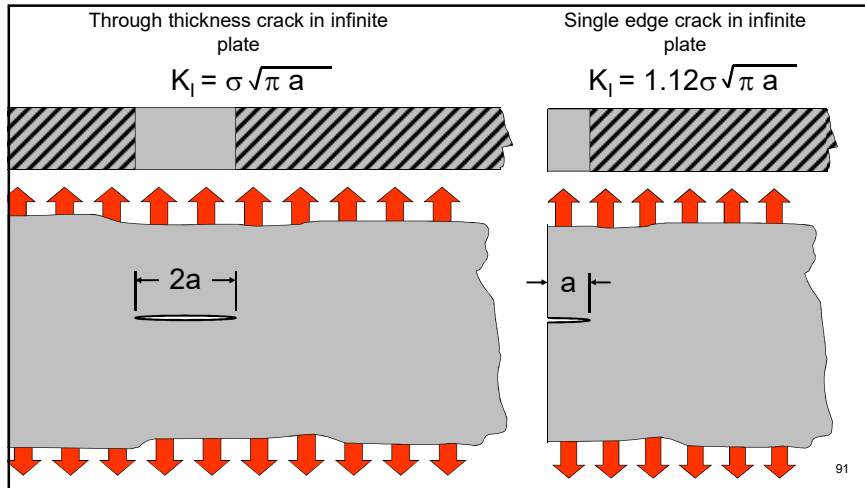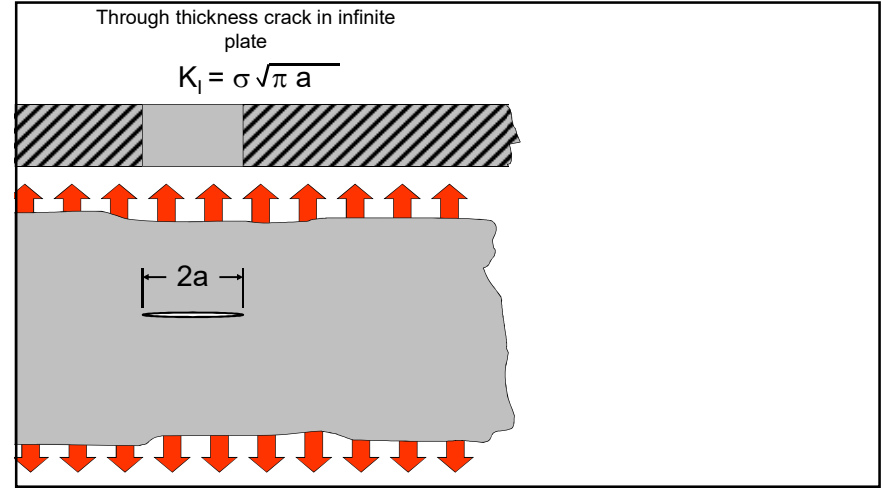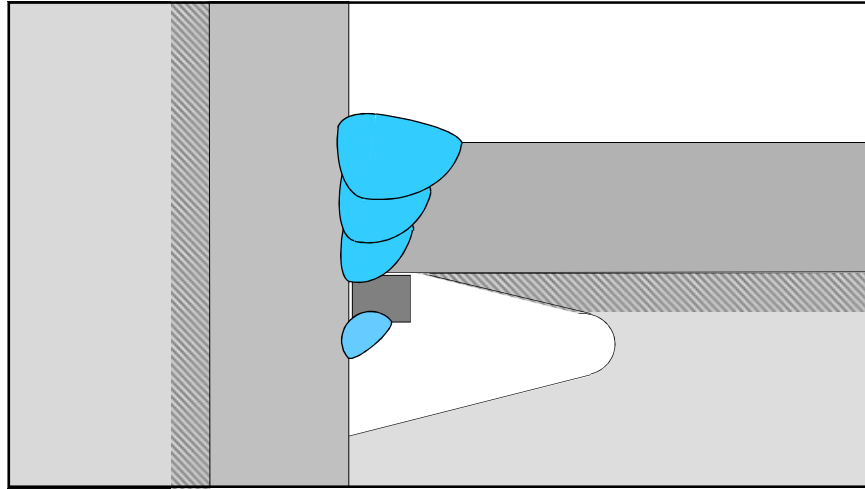

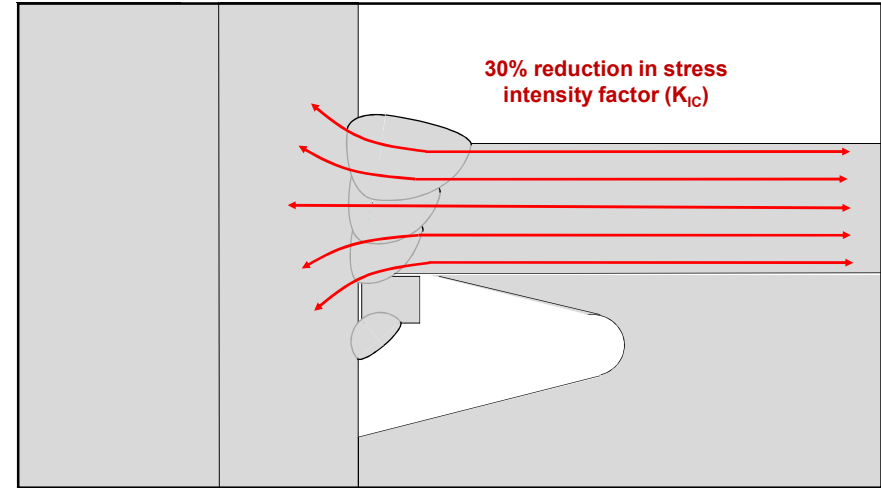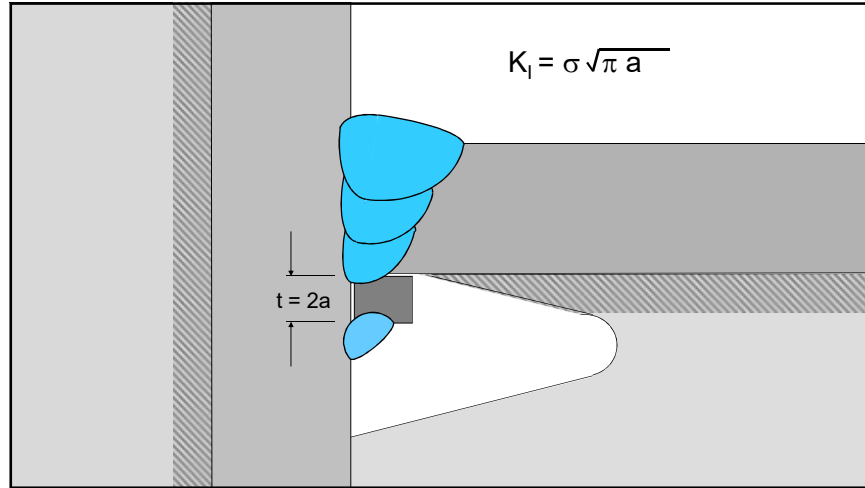



AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

3.3. BACKING AT BEAM-TO-COLUMN AND CONTINUITY PLATE-TO-COLUMN JOINTS


4. Prohibited Welds at Steel Backing



Backing at beam flange-to-column flange joints shall not be welded to the underside of the beam flange, nor shall tack welds be permitted at this location. If fillet welds or tack welds are placed between the backing and the beam flange in error, they shall be repaired as follows:

(1) The weld shall be removed such that the fillet weld or tack weld no longer attaches the backing to the beam flange.



95

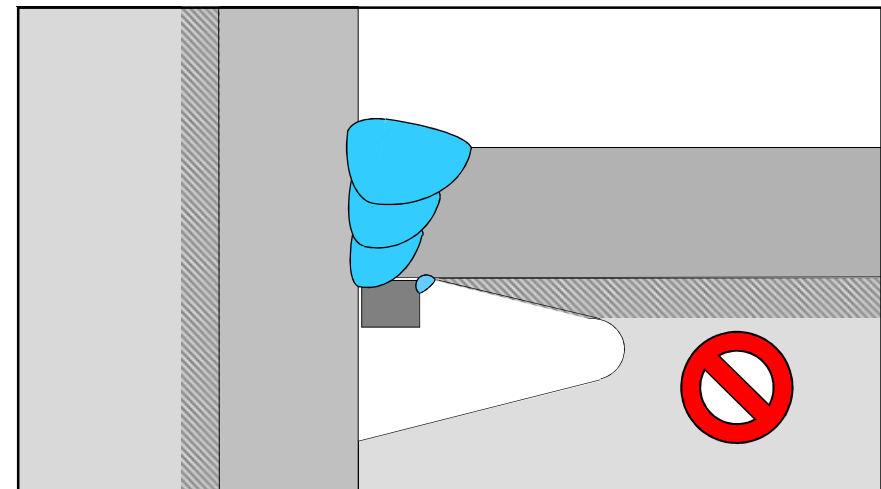

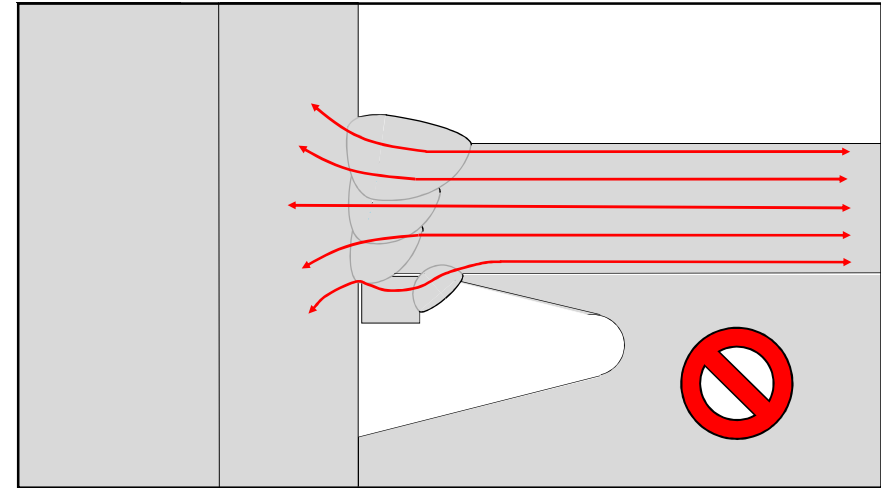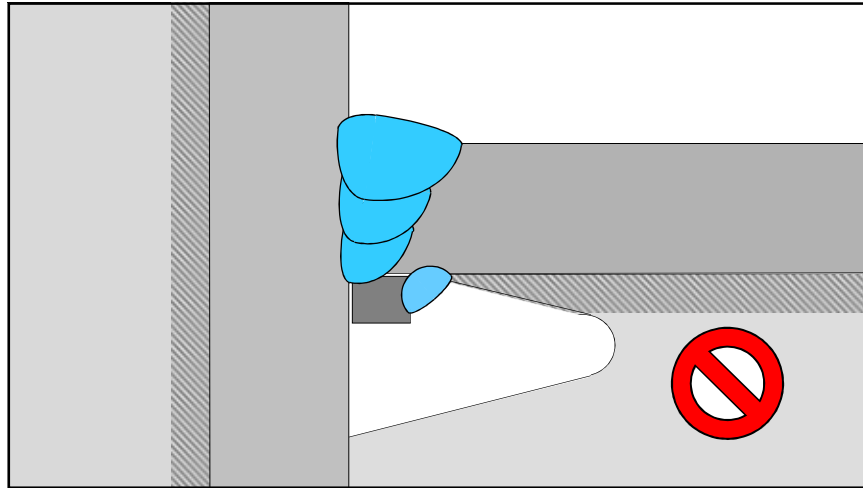

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

3.4. WELD TABS

Where used, weld tabs shall be removed to within 1/8 in. (3 mm) of the base metal surface and the end of the weld finished, except at continuity plates where removal to within 1/4 in. (6 mm) of the plate edge shall be permitted. Removal shall be by air carbon arc cutting (CAC-A), grinding, chipping, or thermal cutting. The process shall be controlled to minimize errant gouging. The edges where weld tabs have been removed shall be finished to a surface roughness of 500 μ -in. (13 microns) or better. The contour of the weld end shall provide a smooth transition to adjacent surfaces, free of notches, gouges, and sharp corners. Weld defects greater






AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

GLOSSARY

Weld tab. Piece of metal affixed to the end of a welded joint to facilitate the initiation and termination of weld passes outside the structural joint.



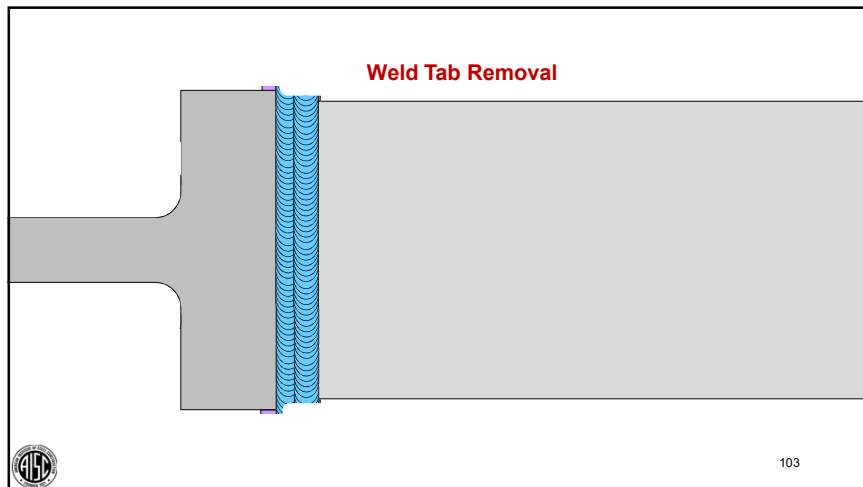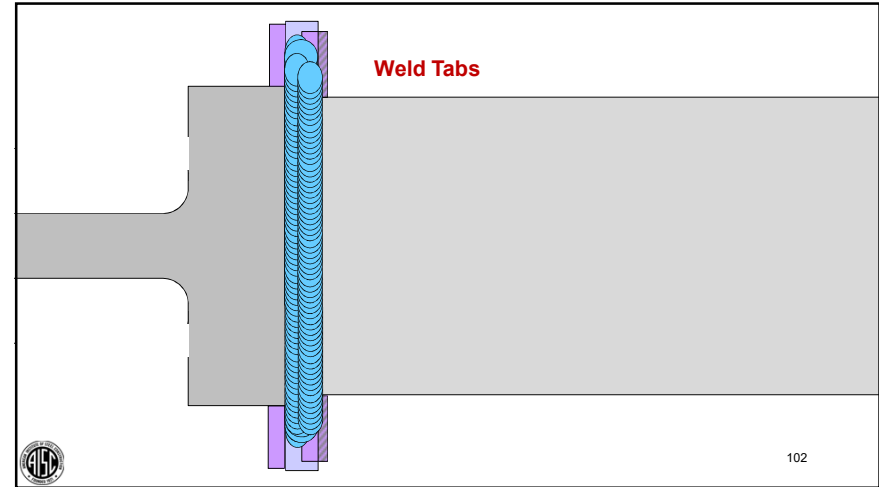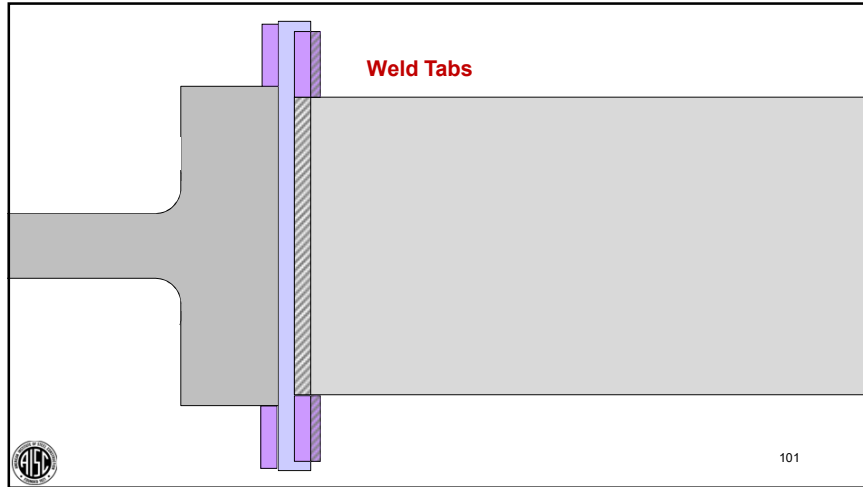


AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

3.5. TACK WELDS

In the protected zone, tack welds attaching backing and weld tabs shall be placed where they will be incorporated into a final weld.




The AISC logo is in the bottom left corner, and the number "104" is in the bottom right corner.

AISC 341-16 SEISMIC PROVISIONS

GLOSSARY

Protected zone. Area of members or connections of members in which limitations apply to fabrication and attachments.




105

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

CHAPTER 2
DESIGN REQUIREMENTS

2.6. PROTECTED ZONE

The protected zone shall be as defined for each prequalified connection. Unless otherwise specifically indicated in this Standard, **the protected zone of the beam shall be defined as the area from the face of the column flange to one-half of the beam depth beyond the plastic hinge.** The protected zone shall meet the requirements of the AISC *Seismic Provisions*, except as indicated in this Standard. Bolt holes in beam webs, when detailed in accordance with the individual connection provisions of this



106

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

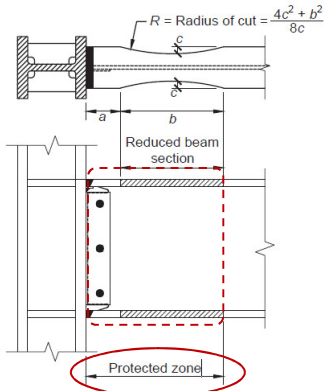



Fig. 5.1. Reduced beam section connection.




107



AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

3.5. TACK WELDS

In the protected zone, tack welds attaching backing and weld tabs shall be placed where they will be incorporated into a final weld.



108

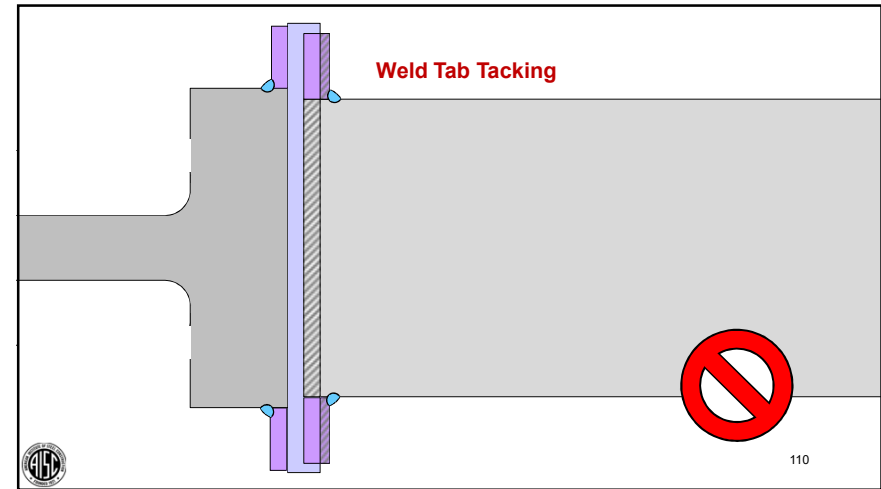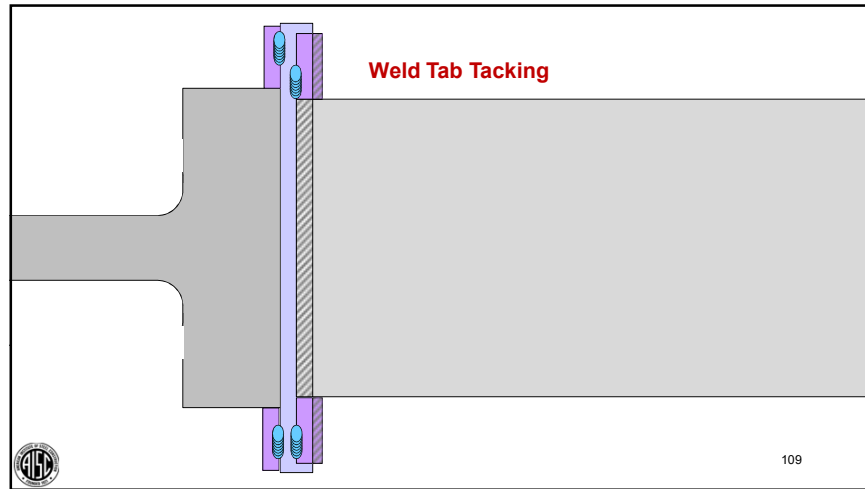

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

3.6. CONTINUITY PLATES

Along the web, the corner clip shall be detailed so that the clip extends a distance of at least 1-1/2 in. (38 mm) beyond the published k_{det} dimension for the rolled shape. Along the flange, the plate shall be clipped to avoid interference with the fillet radius of the rolled shape and shall be detailed so that the clip does not exceed a distance of 1/2 in. (13 mm) beyond the published k_1 dimension. The clip shall be detailed to facilitate suitable weld terminations for both the flange weld and the web weld. When a curved corner clip is used, it shall have a minimum radius of 1/2 in. (13 mm).





111


AISC 360-16 Specification for Structural Steel Buildings

GLOSSARY

k-area. The region of the web that extends from the tangent point of the web and the flange-web fillet (AISC k dimension) a distance 1-1/2 in. (38 mm) into the web beyond the k dimension.

112

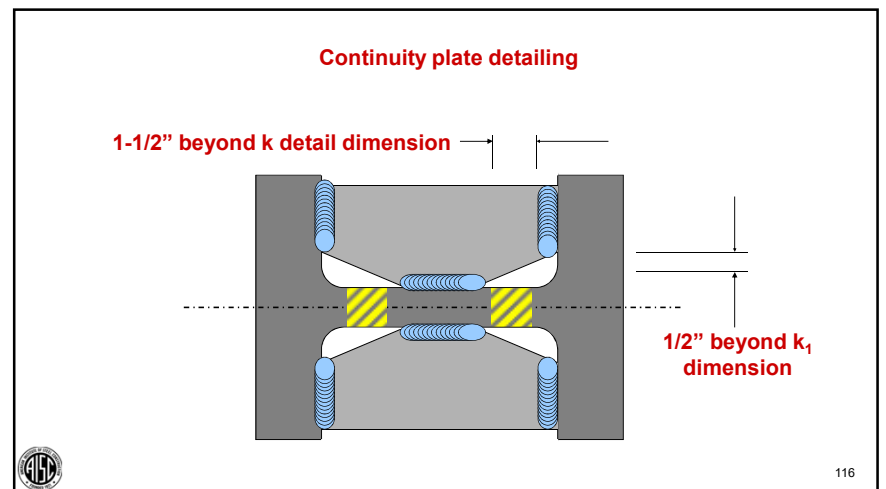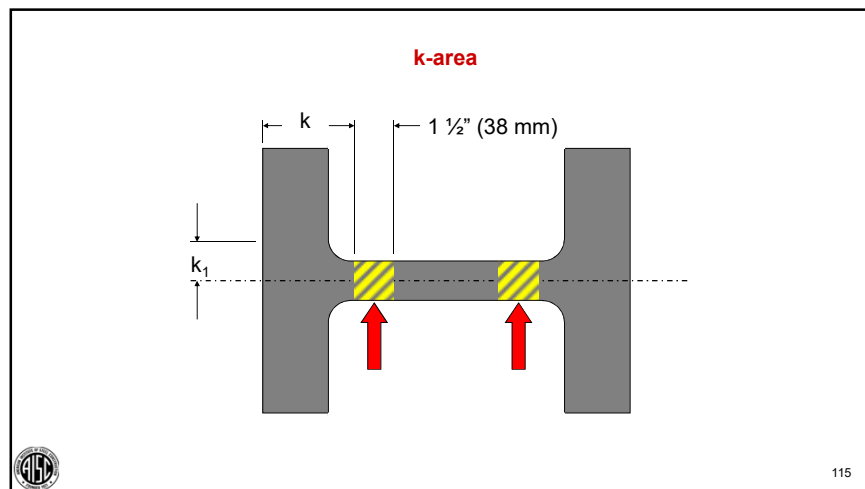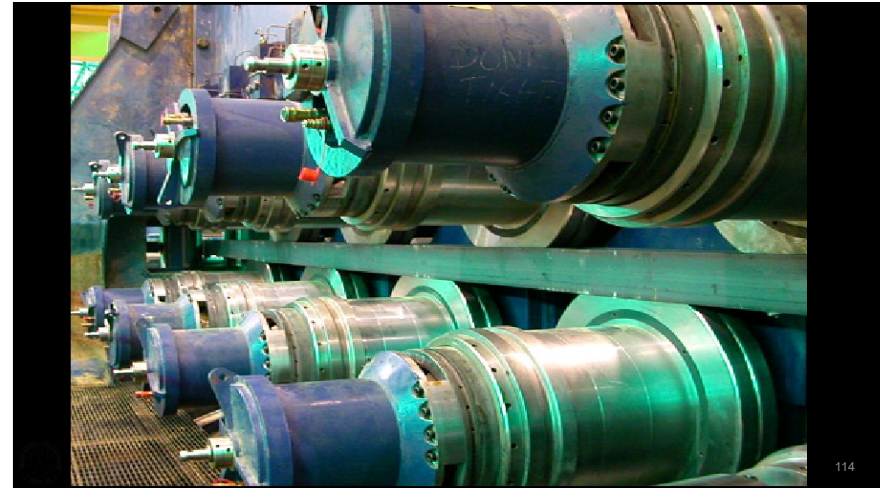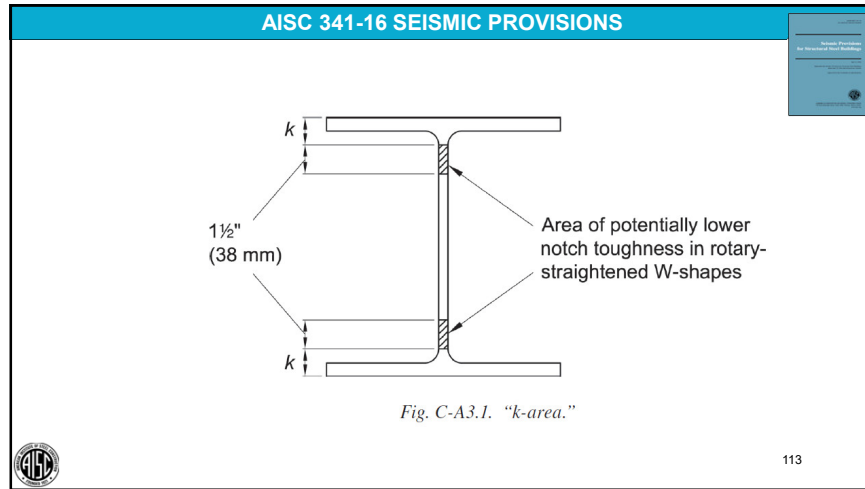

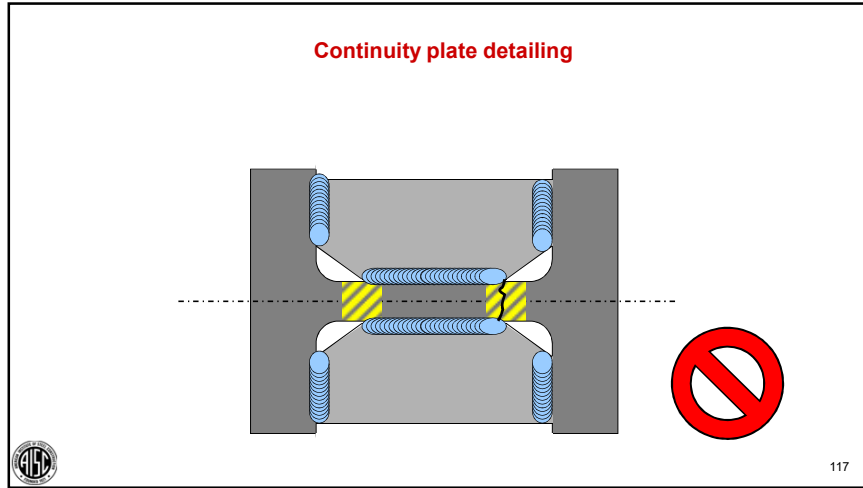

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

3.7. QUALITY CONTROL AND QUALITY ASSURANCE

Quality control and quality assurance shall be in accordance with the AISC Seismic Provisions.

118

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

The Pre-Northridge Moment Connection

Not prequalified in AISC 358

119

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Reduced Beam Section (RBS) Moment Connection

$R = \text{Radius of cut} = \frac{4c^2 + b^2}{8c}$

Protected zone

120

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Bolted Unstiffened and Stiffened Extended End-Plate Moment Connections (BUEEP, BSEEP)

121

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Bolted Flange Plate (BFP) Moment Connection

122

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Bolted Flange Plate (BFP) Moment Connection

123

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Welded Unreinforced Flange-Welded Web (WUF-W) Moment Connection

124

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Kaiser Bolted Bracket (KBB) Moment Connection

Prequalified Connections
Specification for Structural Steel Buildings
Seismic Provisions – Provisions for Seismic Categories I, II, and III
American Institute of Steel Construction, Inc.

125

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

CONXTECH® CONXL™ Moment Connection

Prequalified Connections
Specification for Structural Steel Buildings
Seismic Provisions – Provisions for Seismic Categories I, II, and III
American Institute of Steel Construction, Inc.

126

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

SidePlate® Moment Connection

Prequalified Connections
Specification for Structural Steel Buildings
Seismic Provisions – Provisions for Seismic Categories I, II, and III
American Institute of Steel Construction, Inc.

127

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

COMMENTARY CHAPTER 1




GENERAL

1.3. General

Connections prequalified under this Standard are intended to withstand inelastic deformation primarily through controlled yielding in specific behavioral modes. To obtain connections that will behave in the indicated manner, proper determination of the strength of the connection in various limit states is necessary. The strength formulations contained in the LRFD method are consistent with this approach.

Prequalified Connections
Specification for Structural Steel Buildings
Seismic Provisions – Provisions for Seismic Categories I, II, and III
American Institute of Steel Construction, Inc.

128

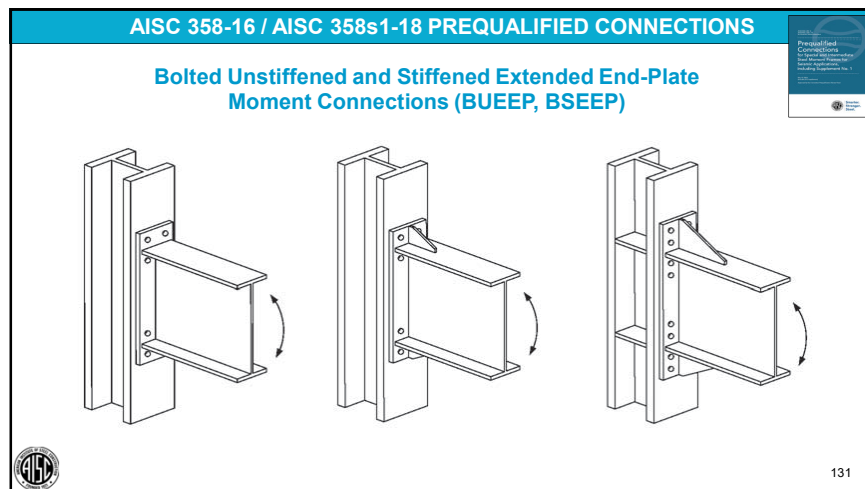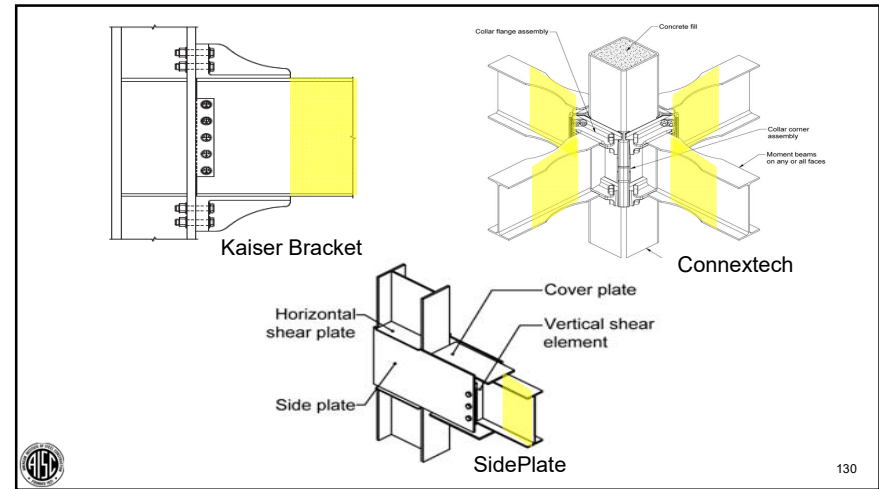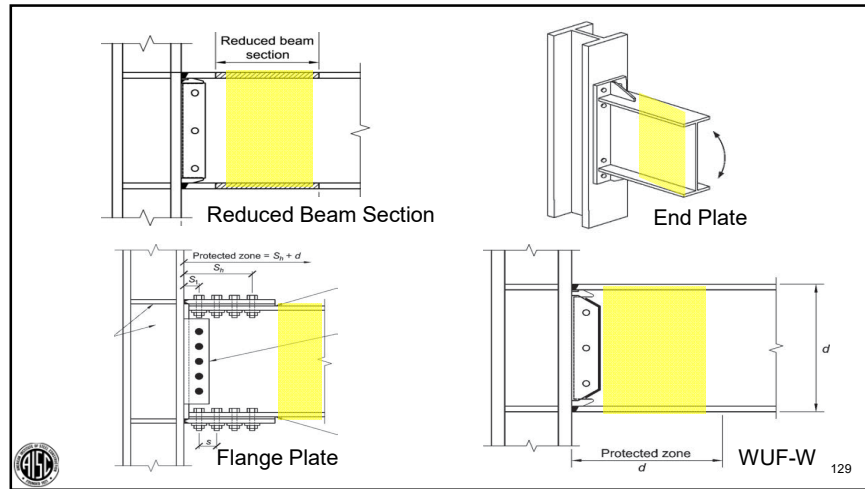

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Bolted Unstiffened and Stiffened Extended End-Plate Moment Connections (BUEEP, BSEEP)

6.7. CONNECTION DETAILING

6. Welding Details

Welding of the beam to the end-plate shall conform to the following limitations:

- (1) **Weld access holes shall not be used.**
- (2) The beam flange to end-plate joint shall be **made using a CJP groove weld without backing.** The CJP groove weld shall be made such that the root of the weld is on the beam web side of the flange. The inside face of the flange shall have a 5/16-in. (8 mm) fillet weld. These welds shall be demand critical.

The AISC logo is in the bottom left corner, and the number 132 is in the bottom right corner.

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Welded Unreinforced Flange-Welded Web (WUF-W) Moment Connection

Protected zone
 d

133

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Welded Unreinforced Flange-Welded Web (WUF-W) Moment Connection

8.5. BEAM FLANGE-TO-COLUMN FLANGE WELDS

Beam flange-to-column flange connections shall satisfy the following limitations:

(2) Weld access hole geometry shall conform to the requirements of AWS D1.8/D1.8M Section 6.11.1.2. Weld access hole quality requirements shall conform to the requirements of AWS D1.8.

134

AWS D1.8:2016 Seismic Welding Supplement

135

$3 t_{bf}$

$3/8''$ min.

25° min.

α

$3 t_{bf}/4$ or $3/4''$ min.


t_{bf} or $1/2''$, whichever is larger

t_{bf}

136


AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

Welded Unreinforced Flange-Welded Web (WUF-W) Moment Connection

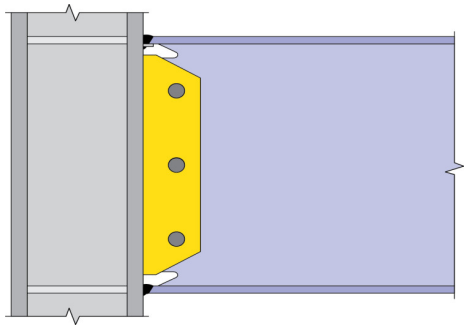

137

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

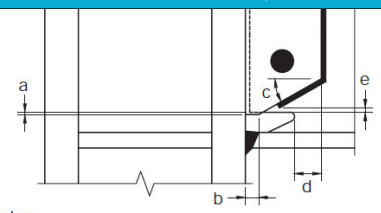

Notes

- a = ¼ in. (6 mm) minimum, ½ in. (12 mm) maximum
- b = 1 in. (25 mm) minimum
- c = 30° (±10°)
- d = 2 in. (50 mm) minimum
- e = ½ in. (12 mm) minimum distance, 1 in. (25 mm) maximum distance from end of fillet weld to edge of access hole

Fig. 8.3. Details at top and bottom of single-plate shear connection.

138

SEISMIC WELDING ISSUES

Chapter 11 Seismic Welding Issues

- 11.1 Introduction
- 11.2 The Northridge Earthquake
- 11.3 Seismic Welding Specifications
- 11.4 Seismic Terminology
- 11.5 AWS D1.8
- 11.6 AISC *Seismic Provisions* Welding Requirements
- 11.7 AISC *Prequalified Connections* Welding Requirements
- ➔ 11.8 Welded Details For Prequalified Connections

139

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

CHAPTER 1
GENERAL

1.1. Scope

This Standard specifies design, detailing, fabrication and quality criteria for connections that are prequalified in accordance with the AISC *Seismic Provisions for Structural Steel Buildings* (herein referred to as the AISC *Seismic Provisions*) for use with special moment frames (SMF) and intermediate moment frames (IMF). The connections contained in this Standard are prequalified to meet the requirements in the AISC *Seismic Provisions* **only when designed and constructed** in accordance with the requirements of this Standard.


140

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS

CHAPTER 3
WELDING REQUIREMENTS

3.1. Filler Metals
Filler metals shall conform to the requirements of the AISC *Seismic Provisions*.

3.2. Welding Procedures
Welding Procedures shall be in accordance with the AISC *Seismic Provisions*.




141

AISC 341-16 SEISMIC PROVISIONS

CHAPTER A
GENERAL REQUIREMENTS

A3 MATERIALS

4. Consumables for Welding
4a. Seismic Force-Resisting System Welds
All welds used in members and connections in the SFRS shall be made with filler metals meeting the requirements specified in clauses 6.1, 6.2 and 6.3 of *Structural Welding Code—Seismic Supplement* (AWS D1.8/D1.8M), hereafter referred to as AWS D1.8/D1.8M.




142

AISC 341-16 SEISMIC PROVISIONS

CHAPTER A
GENERAL REQUIREMENTS

A3 MATERIALS

4. Consumables for Welding
4b. Demand Critical Welds
Welds designated as demand critical shall be made with filler metals meeting the requirements specified in AWS D1.8/D1.8M clauses 6.1, 6.2 and 6.3.




143

AISC 341-16 SEISMIC PROVISIONS

GLOSSARY

Demand critical weld. Weld so designated by these Provisions.



144


AISC 341-16 SEISMIC PROVISIONS

COMMENTARY CHAPTER A
GENERAL REQUIREMENTS

A3. Materials

4. Consumables for Welding

Demand critical welds are generally complete-joint-penetration groove (CJP) welds so designated because they are subject to yield level or higher stress demand and located in a joint whose failure would result in significant degradation in the strength or stiffness of the SRFS.



145

AISC 358-16 / AISC 358s1-18 PREQUALIFIED CONNECTIONS


CHAPTER 3
WELDING REQUIREMENTS

3.1. Filler Metals

Filler metals shall conform to the requirements of the AISC *Seismic Provisions*.

3.2. Welding Procedures

Welding Procedures shall be in accordance with the AISC *Seismic Provisions*.



146

AISC 341-16 SEISMIC PROVISIONS


CHAPTER I
FABRICATION AND ERECTION

I2. FABRICATION AND ERECTION

3. Welded Joints

Welding and welded connections shall be in accordance with AWS D1.8/D1.8M and *Structural Welding Code—Steel* (AWS D1.1/D1.1M), hereafter referred to as AWS D1.1/D1.1M.

Welding procedure specifications (WPS) shall be approved by the engineer of record.



147

AISC 341-16 SEISMIC PROVISIONS


CHAPTER A
GENERAL REQUIREMENTS

A4. Structural Design Drawings and Specifications

2. Steel Construction

In addition to the requirements of Section A4.1, structural design drawings and specifications for steel construction shall indicate the following items, as applicable:

- Configuration of the connections.
- Connection material specifications and sizes.
- Locations of demand critical welds.
- Locations where gusset plates are to be detailed to accommodate inelastic rotation.
- Locations of connection plates requiring Charpy V-notch toughness in accordance with Section A3.3(b)



148


AISC 341-16 SEISMIC PROVISIONS

CHAPTER A
GENERAL REQUIREMENTS

A4. Structural Design Drawings and Specifications

2. Steel Construction (cont'd)

- f) Lowest anticipated service temperature of the steel structure, if the structure is not enclosed and maintained at a temperature of 50° F (10°C) or higher
- g) Locations where weld backing is required to be removed
- h) Locations where fillet welds are required when weld backing is permitted to remain
- i) Locations where fillet welds are required to reinforce groove welds or to improve connection geometry
- j) Locations where weld tabs are required to be removed



149


AISC 341-16 SEISMIC PROVISIONS

CHAPTER A
GENERAL REQUIREMENTS

A4. Structural Design Drawings and Specifications

2. Steel Construction (cont'd)

- k) Splice locations where tapered transitions are required.
 - l) The shape of weld access holes, if a shape other than those provided for in the *Specification* is required
 - m) Joints or groups of joints in which a specific assembly order, welding sequence, welding technique, or other special precautions are required, where such items are designated to be submitted to the engineer of record



150


AISC 341-16 SEISMIC PROVISIONS

CHAPTER D
GENERAL MEMBER AND CONNECTION DESIGN REQUIREMENTS


A4. Structural Design Drawings and Specifications



5. Column Splices

(c) Where butt joints in column splices are made with complete-joint penetration groove welds and when tension stress at any location in the smaller flange exceeds $0.30F_y/\alpha_s$, tapered transitions are required between flanges of unequal thickness or width. Such transitions shall be in accordance with AWS D1.8/D1.8M clause 4.2.



151

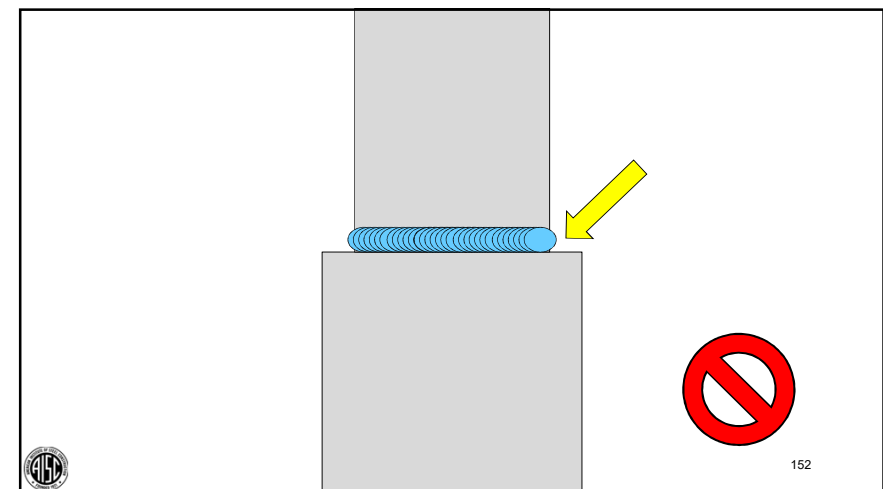

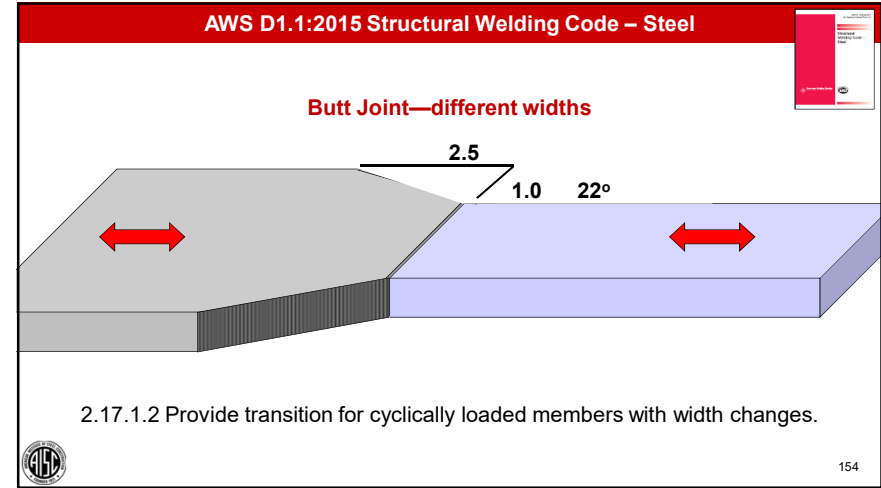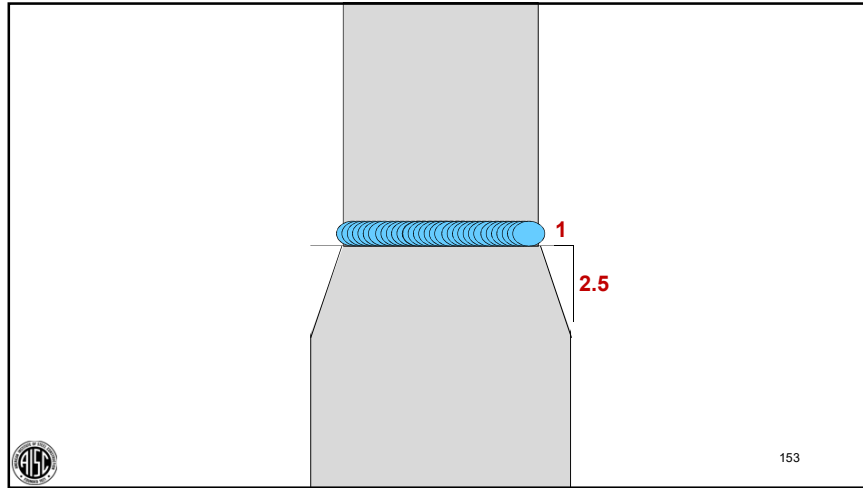

SEISMIC WELDING ISSUES

Outline

- Seismic Design and Ductility
- The Northridge Experience
- AISC Prequalified Seismic Connections
- ➔ • D1.8 Seismic Welding Supplement
- Conclusion

The AISC logo is in the bottom left corner, and the number 155 is in the bottom right corner.


AWS D1.8

Structural Welding Code –
Seismic Supplement

The cover of the book "AWS D1.8 Seismic Supplement" is shown. The cover is red and white. The title "AWS D1.8 Seismic Supplement" is prominently displayed. The AISC logo is in the bottom left corner, and the number 156 is in the bottom right corner.

AWS D1.8:2016 Seismic Welding Supplement

1. General Requirements
2. Normative Reference
3. Terms and Definitions
4. Welded Connection Details
5. Welder Qualification
6. Fabrication
7. Inspection




157

AWS D1.8:2016 Seismic Welding Supplement

Outline

- Overview
- Heat Input Testing
- Restricted Access Welder Qualification
- Fabrication Details



158

AWS D1.8:2016 Seismic Welding Supplement


COMMENTARY

C-1.1 Scope

The provisions contained in this standard complement the AISC Seismic Provisions and are intended to ensure that welded joints that are designed to undergo significant repetitive inelastic strains as a result of earthquakes, or that are used to connect members designed to resist such inelastic strains have **adequate strength, notch toughness, and integrity to perform as intended.**

STRENGTH **TOUGHNESS** **INTEGRITY**

LIMIT STRESS CONCENTRATIONS




159

SEISMIC WELDING ISSUES

STRENGTH

- No new requirements: D1.1 applies





160

SEISMIC WELDING ISSUES

TOUGHNESS

- For members of SFRS: 20 ft-lbs @ 0°F [27J @ -18°C] by AWS A5 classification (Table 6.1)
- For Demand Critical welds: 40 ft-lbs @ +70°F [54J @ +20°C] by special high and low heat input tests (Table 6.2, Annex A)
- Intermix testing for combinations that include FCAW-S (Annex B)
- Controls on wind speed for gas-shielded processes (clause 6.6.3.1)
- Filler metal lot control, or alternatives (clause 6.3.1)
- Maximum interpass temperature control (clause 6.7)





161

SEISMIC WELDING ISSUES

INTEGRITY

- Restricted access welder qualification test (Annex D)
- Bottom flange welding sequence (clause 6.9)
- Welder identification system (clause 6.10)
- Moisture-resistant FCAW packaging (clause 6.4.1)
- Exposure limits for FCAW electrode (clause 6.4.3), including extended exposure tests (Annex E)
- Controls on wind speed for gas-shielded processes (clause 6.6.3.1)
- Inspection criteria for specific conditions (clauses 7.4-7.10)





162

SEISMIC WELDING ISSUES

LIMIT STRESS CONCENTRATIONS

- Protected Zone restrictions (clause 6.18)
- Backing removal (clause 6.13)
- Left-in-place backing treatment (clause 6.15)
- Weld access hole profiles (clause 6.11)
- Weld tab removal (clause 6.16.3)
- Restrictions on end dams (clause 6.17)
- Corner clips and continuity plates and stiffener detailing (clause 4.1)
- Width and thickness transition details (clause 4.2)





163

AWS D1.8:2016 Seismic Welding Supplement

1.1 Scope

The provisions of this code supplement the provisions of AWS D1.1/D1.1M, *Structural Welding Code—Steel*, and shall apply to the design, fabrication, quality control, and quality assurance of welded joints designed in accordance with the AISC *Seismic Provisions for Structural Steel Buildings*.




164

AWS D1.8:2016 Seismic Welding Supplement

1.1 Scope (continued)

All provisions of AWS D1.1/D1.1M for statically loaded structures shall apply to the designated welds, except as specifically modified herein.




165

AWS D1.8:2016 Seismic Welding Supplement

Three kinds of welds:

Type of Weld	D1.1	D1.8	D1.8 DC
Not part of SFRS	✓		
Part of SFRS	✓	✓	
Demand Critical	✓	✓	✓



166

AISC 341-16 SEISMIC PROVISIONS


CHAPTER A
GENERAL REQUIREMENTS

A3 MATERIALS

4. Consumables for Welding

4a. Seismic Force-Resisting System Welds

All welds used in members and connections in the SFRS shall be made with filler metals meeting the requirements specified in clauses 6.1, 6.2 and 6.3 of *Structural Welding Code—Seismic Supplement (AWS D1.8/D1.8M)*, hereafter referred to as AWS D1.8/D1.8M.



167

AWS D1.8:2016 Seismic Welding Supplement


Welds: Part of the SFRS

Table 6.1
Filler Metal Mechanical Property Requirements

Property	Classification Strength Levels		
	70 ksi [490 MPa]	80 ksi [550 MPa]	90 ksi [620 MPa]
Yield Strength, ksi [MPa] ^a	58 [400] min.	68 [470] min.	78 [540] min.
Tensile Strength, ksi [MPa]	70 [490] min.	80 [550] min.	90 [620] min.
Elongation (%)	22 min.	19 min.	17 min.
CVN Toughness, ft-lbf [J] ^b	20 [27] min. @ 0°F [-18°C]	20 [27] min. @ 0°F [-18°C]	25 [34] min. @ -20°F [-30°C]

^a 0.2% offset method.
^b Filler metals classified as meeting the required absorbed energy at a temperature lower than the required test temperature also meet this requirement.

20 ft-lbs @ 0°F



168

AISC 341-16 SEISMIC PROVISIONS


CHAPTER A
GENERAL REQUIREMENTS

A3 MATERIALS

4. Consumables for Welding

4b. Demand Critical Welds

Welds designated as demand critical shall be made with filler metals meeting the requirements specified in AWS D1.8/D1.8M clauses 6.1, 6.2 and 6.3.



169

AWS D1.8:2016 Seismic Welding Supplement

Demand Critical Welds


Table 6.2
Mechanical Property Requirements for Demand Critical Welds

Property	Classification Strength Levels		
	70 ksi [490 MPa]	80 ksi [550 MPa]	90 ksi [620 MPa]
Yield Strength, ksi [MPa] ^a	58 [400] min.	68 [470] min.	78 [540] min.
Tensile Strength, ksi [MPa]	70 [490] min.	80 [550] min.	90 [620] min.
Elongation (%)	22 min.	19 min.	17 min.
CVN Toughness, ft-lbf [J] ^{b,c}	40 [54] min. @ +70°F [+20°C]	40 [54] min. @ +70°F [+20°C]	40 [54] min. @ +50°F [+10°C]

^a 0.2% offset method.
^b For LAST of +50°F [+10°C]. For LAST less than +50°F [+10°C], see 6.2.2.
^c Tests conducted in accordance with Annex A meeting 40 ft-lbf [54 J] min. at a temperature lower than the required test temperature also meet this requirement.

40 ft-lbs @ 70°F in hi/lo tests for LAST of +50°F


DEMAND CRITICAL

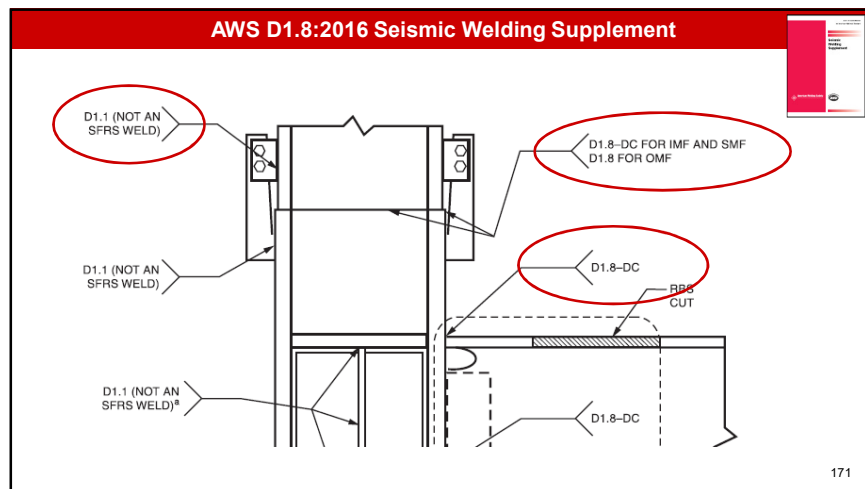

AWS D1.8:2016 Seismic Welding Supplement

Outline

- Overview
- ➔ • Heat Input Testing
- Restricted Access Welder Qualification
- Fabrication Details



172

AWS D1.8:2016 Seismic Welding Supplement

Annex A (Normative)

WPS Heat Input Envelope Testing of
Filler Metals for Demand Critical Welds

A1. Purpose

This annex provides testing procedures used to determine the suitability of filler metals to be used in producing Demand Critical welds in accordance with this code. These procedures are intended to assure that welds deposited with filler metals tested in accordance with these procedures will be capable of providing welded joints with the required strength, ductility, and notch toughness at the anticipated service temperatures, for the range of heat input rates that may be experienced under the production WPS.

A4. Test Plate Details

Two test plates shall be required, one for each heat input level. The test plate shall be as shown in Figure A.1. Plates for qualification of E7X [E48X] filler metals shall conform either to ASTM A36, A572 Grade 50, or A992. Plates for qualification of E80 [E55] filler metals shall conform to either ASTM A36, A572 Grade 50, ASTM A572 Grade 65, or A913 Grade 50, at the Contractor's option. Plates for qualification of E90 [E62] filler metals shall conform to either A572 Grade 50, ASTM A572 Grade 65, A913 Grade 65, or A913 Grade 70 at the Contractor's option. Steel backing shall be of one of the six specifications and grades listed above, but need not be the same as the base material used for the qualification test plates.

173

$HI = \frac{60 E I}{1000 S} \text{ KJ/in [KJ/mm]}$

176


$HI = \frac{60 E I}{1000 S}$




High Heat Input ➔ **Slow Cooling Rates** ➔ **Poorer Notch Toughness**

Low Heat Input ➔ **High Cooling Rates** ➔ **Poorer Notch Toughness**

Medium Heat Input ➔ **Medium Cooling Rates** ➔ **Optimal Notch Toughness**

176

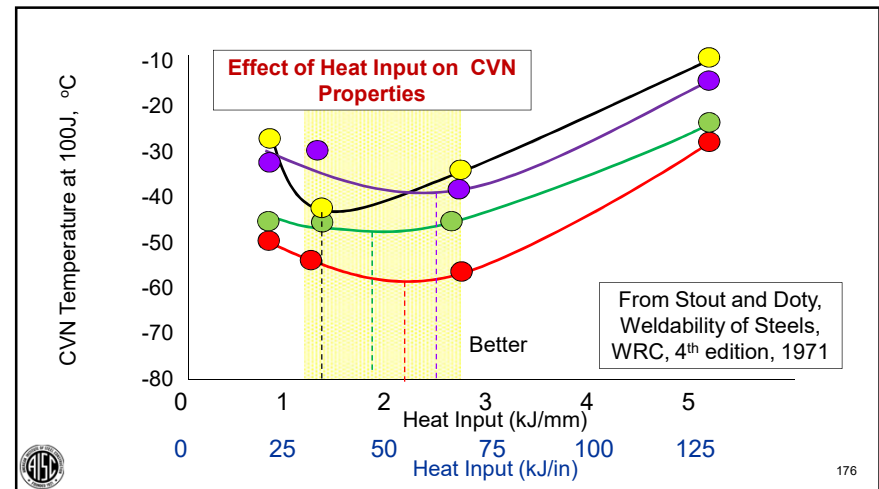

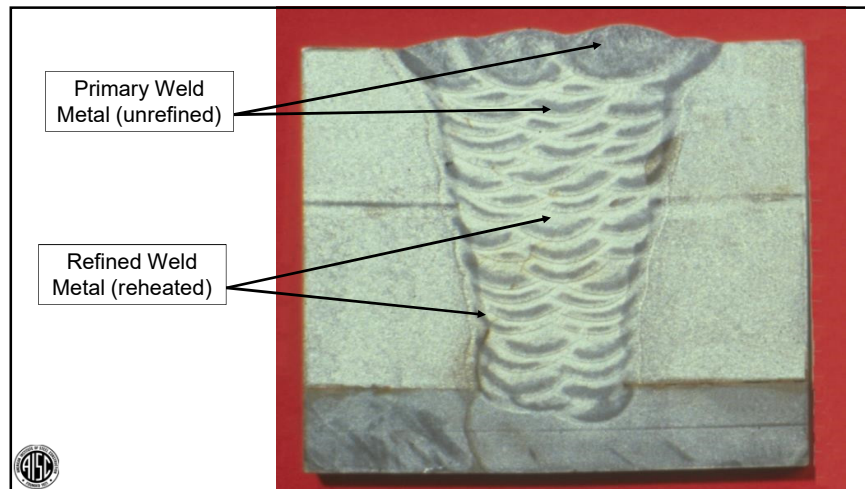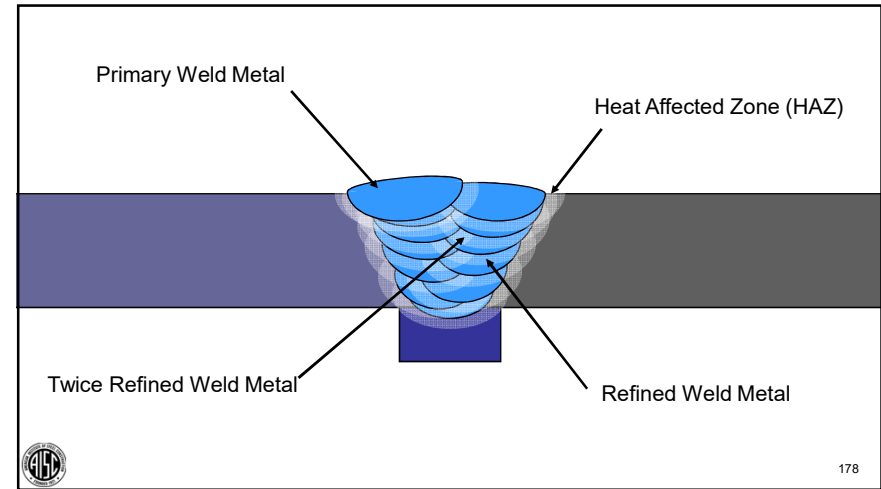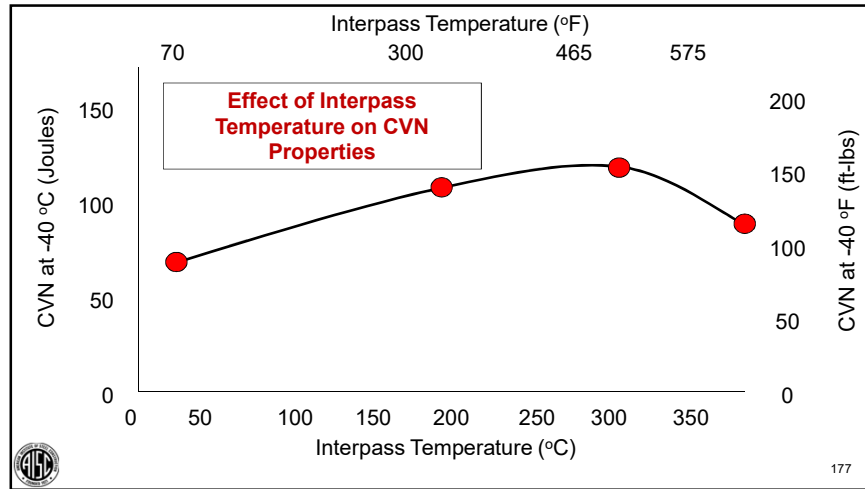

AWS D1.8:2016 Seismic Welding Supplement

**Table A.1
Heat Input Envelope Testing—Heat Input, Preheat, and Interpass Temperatures**

	Suggested Heat Input	Maximum Preheat Temperature	Maximum Interpass Temperature
Low Heat Input Test	30 kJ/in [1.2 kJ/mm]	120°F [40°C]	250°F [120°C]
	Suggested Heat Input	Minimum Preheat Temperature ^a	Minimum Interpass Temperature ^a
High Heat Input Test	80 kJ/in [3.1 kJ/mm]	250°F [120°C]	450°F [240°C]


^a For the high heat input test, the test plate shall be heated to the minimum preheat, and then welding shall begin. Welding shall continue without substantial, deliberate interruption until the minimum interpass temperature is obtained. After the test plate has been heated to the minimum interpass temperature, all subsequent weld passes shall be made at a temperature not less than the minimum interpass temperature. Should the test plate temperature fall below the minimum interpass temperature for any reason, the test plate shall be heated to a temperature not less than the minimum interpass temperature before welding resumes. If the required interpass temperature is not achieved prior to interruption of the welding operations, welding shall not resume until the test assembly has been heated to the prescribed minimum interpass temperature.

Low Heat Input Test 30 KJ/ in [1.2 KJ/mm] (suggested)
High Heat Input Test 80 KJ/ in [3.1 KJ/mm] (suggested)

AWS D1.8:2016 Seismic Welding Supplement

Outline

- Overview
- Heat Input Testing
- ➔ • Restricted Access Welder Qualification
- Fabrication Details




181

AWS D1.8:2016 Seismic Welding Supplement


Annex D (Normative)
Supplemental Welder Qualification for Restricted Access Welding

D1. Purpose


This annex provides supplemental welder qualification testing procedures for welders who will perform production welding on Demand Critical beam bottom flange to column joints, where such welds must be performed by welding through a weld access hole. Welders previously qualified using similar restricted access plate tests, prior to adoption of this code, shall be deemed qualified under these provisions for the duration of their qualification period.



182

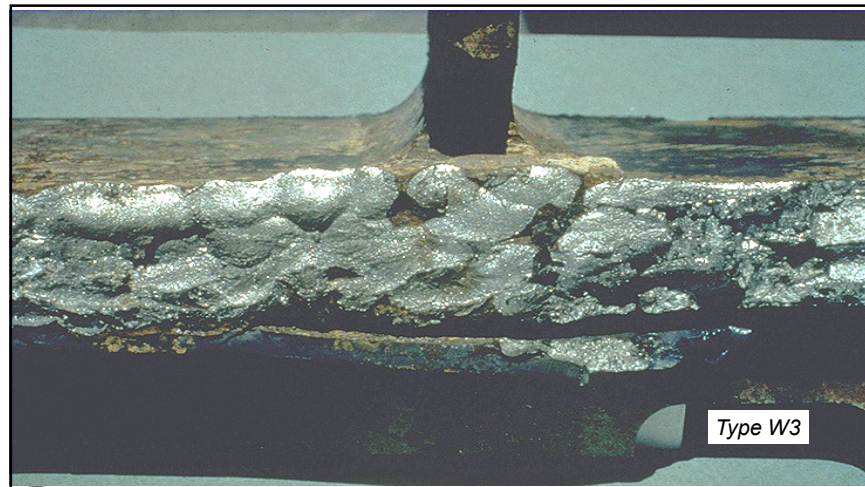


AWS D1.8:2016 Seismic Welding Supplement

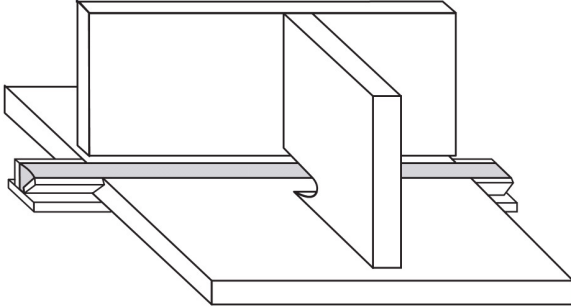


Notes:

1. The web location shall be marked on the test plates prior to disassembling the test configuration (see D3.1.4).
2. The web plate shall be centered on the test plate.

Figure D.3—Test Plate Configuration Illustration (see D2)



184

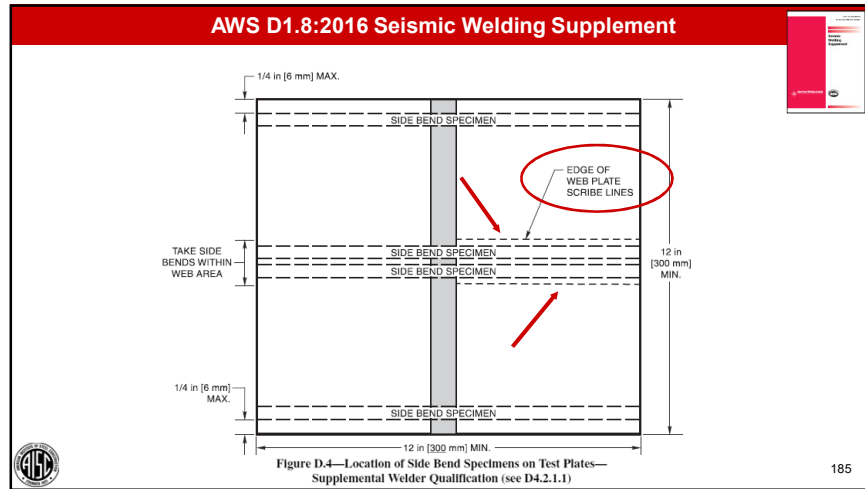

AWS D1.8:2016 Seismic Welding Supplement

D3.1.2 Welding Procedure Specification.

The test plate assembly shall be welded in accordance with a WPS using the process for which the welder is being qualified. The combination of variables shall be such that the deposition rate used in the qualification test is equal to or greater than the highest deposition rate that will be used in production.

186


- AWS D1.8:2016 Seismic Welding Supplement**
- ### Outline
- Overview
 - Heat Input Testing
 - Restricted Access Welder Qualification
 - ➔ • Fabrication Details
- 187

AWS D1.8:2016 Seismic Welding Supplement

6.16.1 Minimum Weld Tab Length.

Where practicable, weld tabs shall extend a minimum of 1 inch [25 mm] or the thickness of the part, whichever is greater, beyond the edge of the joint. Weld tab length need not exceed 2 inches [50 mm]. Where there is inadequate access for weld tabs, such as with closely spaced pieces or pieces intersecting at acute angles, weld ends may be cascaded for approximately one weld size.

188

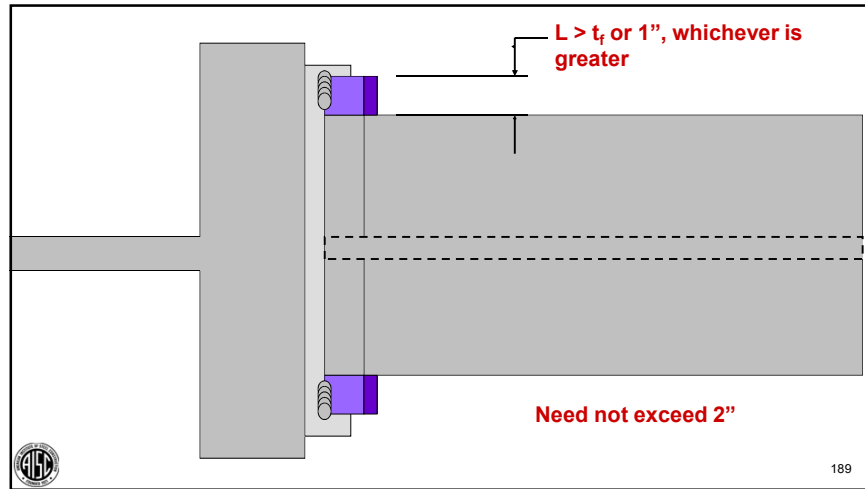


AWS D1.8:2016 Seismic Welding Supplement


6.18 Protected Zone

6.18.1 Attachments and Welds.

Welded attachments, including stud welds and fasteners for the connection of other materials, shall be prohibited within the Protected Zone. Arc spot welds (puddle welds) for the attachment of metal decking shall be permitted in the Protected Zone.

190

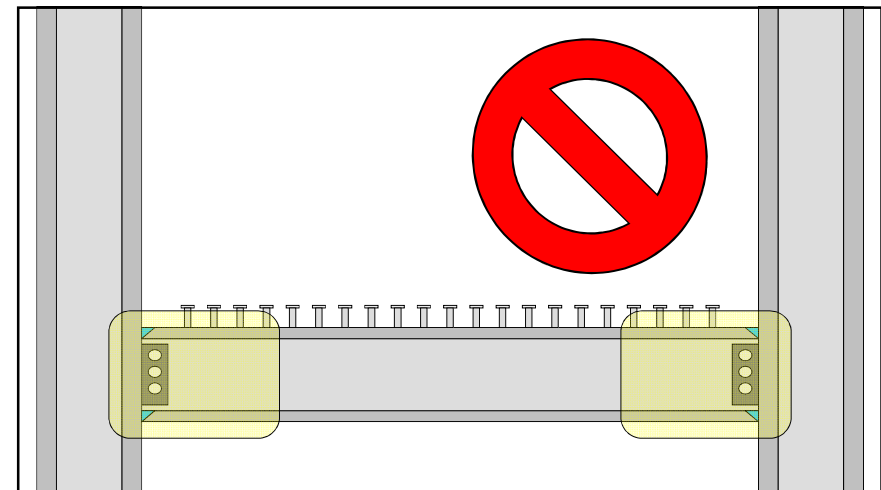

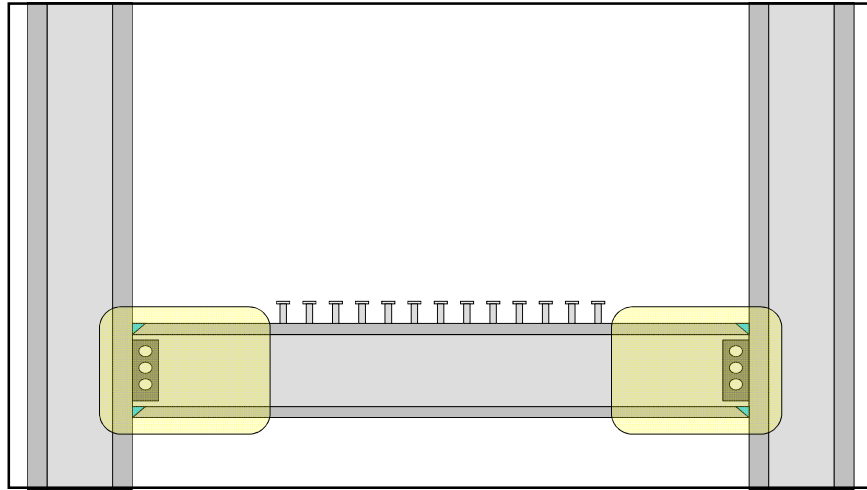


AWS D1.8:2016 Seismic Welding Supplement



6.18 Protected Zone


6.18.1 Attachments and Welds.

Welded attachments, including stud welds and fasteners for the connection of other materials, shall be prohibited within the Protected Zone. Arc spot welds (puddle welds) for the attachment of metal decking shall be permitted in the Protected Zone.



194

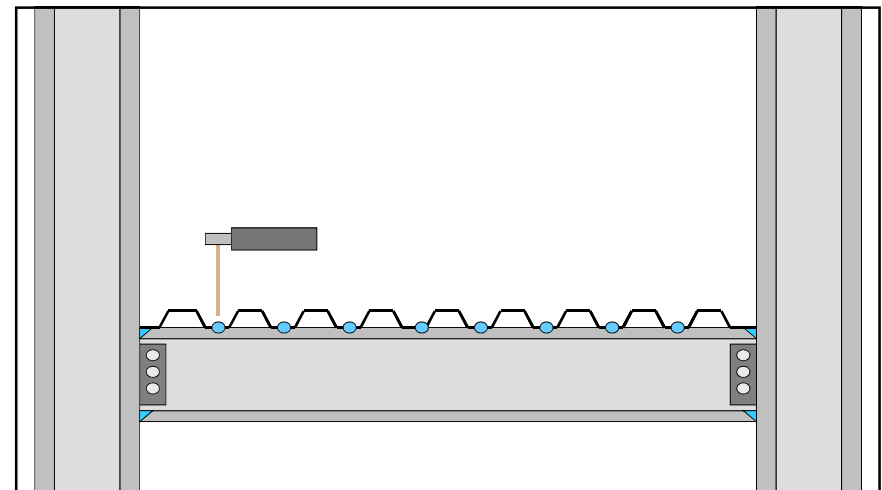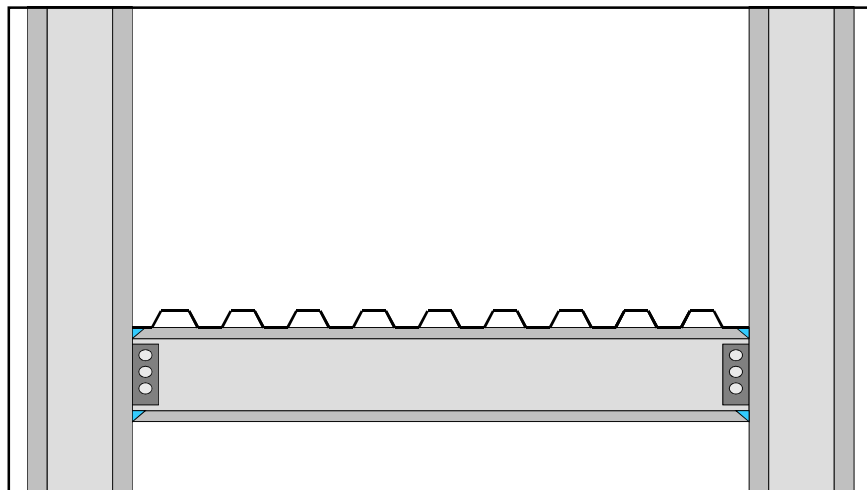

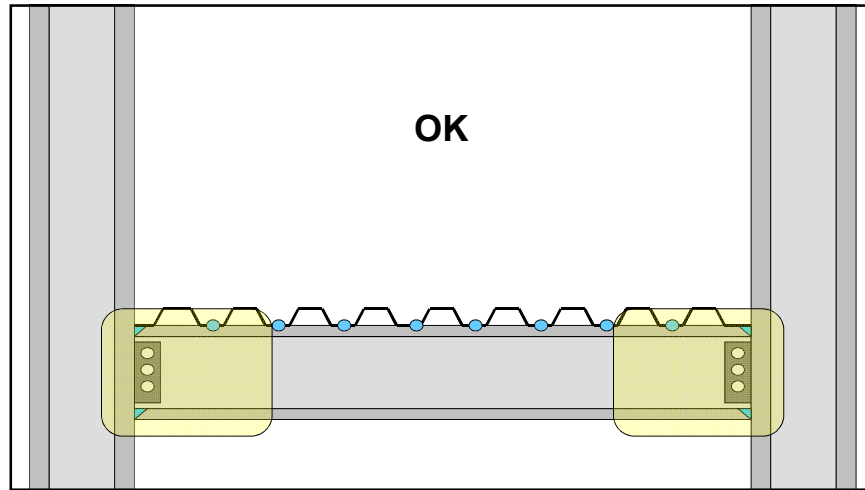



AWS D1.8:2016 Seismic Welding Supplement

6.18 Protected Zone

6.18.2 Erection Aids.

If erection aids are required to be attached within the Protected Zone, the Contractor shall obtain the Engineer's approval for the use of such attachments.





198

AWS D1.8:2016 Seismic Welding Supplement

Outline

- Overview
- Heat Input Testing
- Restricted Access Welder Qualification
- Fabrication Details





199


SEISMIC WELDING ISSUES

Outline

- Seismic Design and Ductility
- The Northridge Experience
- AISC Prequalified Seismic Connections
- D1.8 Seismic Welding Supplement
- ➔ • Conclusion



200

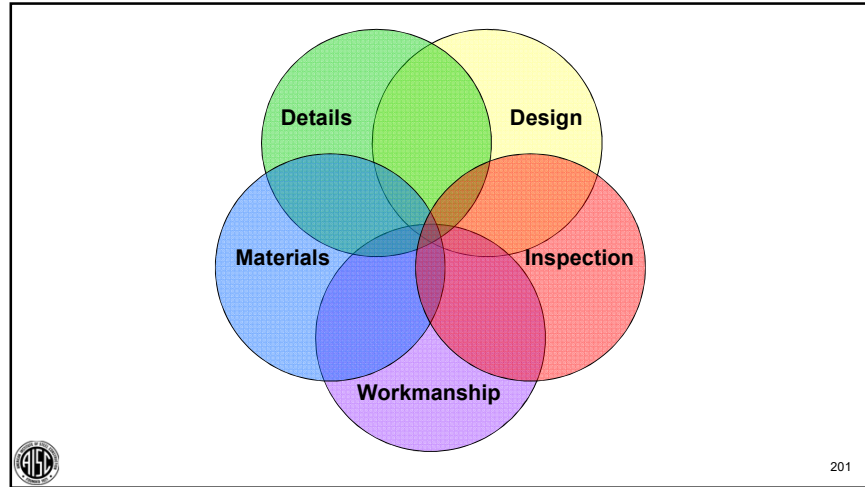

SEISMIC WELDING ISSUES

202

Thank you!

AISC | Questions?

203

Individual Session Registrants

PDH Certificates

- You will receive an email on how to report attendance from: registration@aisc.org.
- Be on the lookout: Check your spam filter! Check your junk folder!
- Completely fill out online form. Don't forget to check the boxes next to each attendee's name!

204

Individual Session Registrants

PDH Certificates

- Reporting site (URL will be provided in the forthcoming email).
- Username: Same as AISC website username.
- Password: Same as AISC website password.



8-Session Registrants

PDH Certificates

One certificate will be issued at the conclusion of all 8 sessions.



8-Session Registrants

Access to the quiz

Information for accessing the quiz will be emailed to you by Thursday. It will contain a link to access the quiz. EMAIL COMES FROM NIGHTSCHOOL@AISC.ORG.

Quiz and attendance records

Posted Thursday mornings. www.aisc.org/nightschool -- Click on Current Course Details.

Reasons for quiz

- EEU – You must take all quizzes and the final exam to receive EEU.
- PDHs – If you watch a recorded session, you must pass quiz for PDHs.
- REINFORCEMENT – Reinforce what you learn tonight. Get more out of the course.

Note: If you attend the live presentation, you do not have to take the quizzes to receive PDHs



8-Session Registrants

Access to the recording

Information for accessing the recording will be emailed to you by Thursday. The recording will be available for four weeks. (For 8-session registrants only.) EMAIL COMES FROM NIGHTSCHOOL@AISC.ORG.

PDHs via recording

If you watch a recorded session, you must take *and pass* the quiz for PDHs.



8-Session Registrants

Night School Resources

Find all your handouts, quizzes and quiz scores, recording access, and attendance information all in one place!



8-Session Registrants

Night School Resources

Go to www.aisc.org and sign in.



Login

If you're an existing customer, please enter your username and password.

USERNAME

Enter your username

PASSWORD

Enter your password

Remember Me

DON'T HAVE AN ACCOUNT?

My AISC allows you to access Engineering Journal articles and Design Guides you have downloaded from the bookstore.

[REGISTER NOW](#)



8-Session Registrants

Night School Resources

Go to www.aisc.org and sign in.

IN THIS SECTION

[Edit Profile](#)

[My Downloads](#)

[My Pending Quizzes](#)

[My Events](#)

[Order History](#)

[Course History](#)

[Course Resources](#)

MyAISC

MY PROFILE

Update your contact and address information.

[EDIT PROFILE](#)

MY PURCHASED DOWNLOADS

Access articles and documents that you have purchased.

[VIEW DOWNLOADS](#)

MY COURSE RESOURCES

View online resources for Night School and Live Webinar package registrations.

[VIEW RESOURCES](#)



8-Session Registrants

Night School Resources




Course Resources

Event	Start Date
NS 13 8-Session Package: Night School 13 - Design of Industrial Buildings	1/30/2017 7:00:00 PM
NS 14 8-Session Package: Night School 14 - Fundamentals of Stability	6/5/2017 7:00:00 PM




8-Session Registrants

Night School Resources




Event	Date	Handouts	Video	Quiz	Attendance
NS13 - Design Criteria	1/30/2017 7:00:00 PM	Handouts	Video Passcode: NS1315D4	Pass Score: 80	Pending
NS13 - Economic Considerations	2/6/2017 7:00:00 PM	Handouts	Available 02/08/2017 5pm EST	Available 02/08/2017 5pm EST	Pending
NS13 - Lateral Load Systems and Details	2/13/2017 7:00:00 PM	Handouts	Available 02/15/2017 5pm EST	Available 02/15/2017 5pm EST	Pending
NS13 - Preliminary Design Procedures	2/27/2017 7:00:00 PM	Handouts	Available 03/05/2017 5pm EST	Available 03/05/2017 5pm EST	Pending
NS13 - Crane Girder Design and Frame Analysis	3/6/2017 7:00:00 PM	Handouts	Available 03/08/2017 5pm EST	Available 03/08/2017 5pm EST	Pending
NS13 - Frame Member and Connection Design	3/13/2017 7:00:00 PM	Handouts	Available 03/15/2017 5pm EST	Available 03/15/2017 5pm EST	Pending
NS13 - Transfer Crane Girder & Longitudinal Brag Bracing Dn	3/27/2017 7:00:00 PM	Handouts	Available 03/29/2017 5pm EST	Available 03/29/2017 5pm EST	Pending



8-Session Registrants

Night School Resources


- Weekly “quiz and recording” email.
- Weekly updates of the master quiz and attendance record, found at www.aisc.org/nightschool21. Scroll down to Quiz and Attendance records.
 - Updated on Thursday mornings.



8-Session Registrants

Night School Resources

- Webinar connection information
 - Reminder email sent out Tuesday mornings
- Links to handouts also found here




AISC | Thank you

